



Operating Instructions

Membrane Metering Pump

Ritmo 031-xx

FINK Chem + Tec GmbH & Co. KG

Maybachstraße 11

70771 Leinfelden-Echterdingen

Tel. 0711-99755427

Fax 0711-99755428

info@finkct.de

www.finkct.de

Contents

Index of contents

1.	Safety instructions	4
1.1	Identification of safety instructions in these instructions	4
1.2	Qualification and training of personnel	4
1.3	Safety instructions for the operator/ user	4
1.4	Safety of the system in the event of a failure in the dosing pump	5
1.5	Dosing chemicals	5
1.6	Safety instructions for service, inspection and mounting	5
2.	General	6
2.1	Warranty	6
2.2	Applications	6
2.3	Improper operating methods	6
2.4	Nameplate	7
2.5	Type key	8
2.6	Device overview	9
3.	Technical data / dimensions	9
3.1	Technical data	9,10
3.2	Dimensions	11
4.	Assembly and installation	12
4.1	Pump assembly	12
4.1.1	Requirements	12
4.1.2	Align and install mounting plate	12
4.1.3	Engage pump in mounting plate	12
4.2	Hydraulic connection	13
4.3	Electrical connection	14
5.	Commissioning	15
5.1	General notes	15
5.2	Check before commissioning	16
5.3	Start and de-rate the pump	16
6.	Operation	16
6.1	Operating elements	16
6.2	Operation modes	17
6.2.1	Manual	17
6.2.2	Pulse	17
6.2.3	Change operation modes	18
6.3	Inputs	18
6.3.1	External stop	18
6.3.2	Empty signal	18
6.3.3	Change contact type	18
7.	Service	18
7.1	Service intervals	19
7.2	Perform service	19
7.2.1	Dosing head overview	19
7.2.2	Dismantling the diaphragm and valves	19
7.2.3	Reassembling the diaphragm and valves	20
7.3	Repairs	20
8.	Faults	20
8.1	Indication of faults	20
8.1	List of faults	21

9.	Disposal	21
10.	Safety declaration	22
11.	EG- Declaration of Conformity	23

1. Safety instructions

These installation and operating instructions contain general instructions that must be observed during installation, operation and maintenance of the pump.

It must therefore be read by the installation engineer and the relevant qualified operator prior to installation and start-up, and must be available at the installation location at all times.

Apart from these general safety instructions there are further special instructions in other sections to which attention must be given.

The instructions mounted directly on the metering pump must be heeded and always kept in a visible condition.

Besides the general safety instructions the operator must consider the existing national regulations for accident prevention as well as the internal working, company, and safety regulations.

1.1. Identification of safety instructions in these instructions

The safety instructions are identified by the following symbols:



Warning

If these safety instructions are not observed, it may result in personal injury!



If these safety instructions are not observed, it may result in malfunction or damage to the equipment!



Notes or instructions that make the job easier and ensure safe operation.

1.2 Qualification and training of personnel

The personnel responsible for the installation, operation and service must be appropriately qualified for these tasks. Areas of responsibility, levels of authority and the supervision of the personnel must be precisely defined by the operator. If necessary, the personnel must be trained appropriately.

Risks of not observing the safety instructions

Non-observance of the safety instructions may have dangerous consequences for the personnel, the environment and the pump and may result in the loss of any claims for damages.

It may lead to the following hazards:

- Personal injury from exposure to electrical, mechanical and chemical influences.
- Damage to the environment and personal injury from leakage of harmful substances.

1.3 Safety instructions for the operator/ user

The safety instructions described in these instructions, existing national regulations on health protection, environmental protection and for accident prevention and any internal working, operating and safety regulations of the operator must be observed.

Information attached to the pump must be observed.

Leakages of dangerous substances must be disposed of in a way that is not harmful to the personnel or the environment.

Damage caused by electrical energy must be prevented, see the regulations of the local electricity supply company and the regulations VDE.



Before starting work on the pump, the pump must be disconnected from the mains. The system must be pressureless!

Only original accessories and original spare parts should be used. Using other parts can result in exemption from liability for any resulting consequences.

An existing guards for moving parts must not be removed while the system is in operation.

1.4 Safety of the system in the event of a failure in the dosing pump

The dosing pump was designed according to the latest technologies and is carefully manufactured and tested.

If it fails regardless of this, the safety of the overall system must be ensured. Use the relevant monitoring and control functions for this.

Caution Make sure that any chemicals that are released from the pump or any damaged lines do not cause damage to system parts and buildings. The installation of leak monitoring solutions and drip trays is recommended.

1.5 Dosing chemicals



Warning

Before switching the supply voltage back on, the dosing lines must be connected in such a way that any chemicals in the dosing head cannot spray about and put people at risk.

The dosing medium is pressurized and can be harmful to health and the environment.



Warning

When working with chemicals, the accident prevention regulations applicable at the installation site should be applied (e.g. wearing protective clothing).

Observe the chemical manufacturer's safety data sheets and safety instructions when handling chemicals!



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 2).

Take suitable precautions to prevent harm to health and damage to property from escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

Changing the diaphragm, see section 7. *Service*.

Caution

A deaeration hose, which is routed into a container, e.g. a drip tray, must be connected to the deaeration valve.

Caution

The dosing medium must be in liquid aggregate state!

Observe the freezing and boiling points of the dosing medium!

Caution

The resistance of the parts that come into contact with the dosing medium, such as the dosing head, valve ball, gaskets and lines, depends on the medium, media temperature and operating pressure.

Ensure that parts in contact with the dosing medium are resistant to the dosing medium under operation conditions.

Should you have any questions regarding the material resistance and suitability of the pump for specific dosing media, please contact with Fink Chem + Tec OHG

1.6 Safety instructions for service, inspection and mounting

The organization is responsible for execution of all service, inspection and mounting work is only done through authorized qualified persons who are instructed with an adequate study of the mounting and operating instructions.

Fundamentally, all work on the metering pump is executed only when the pump is not running. The stopping procedure of the pump must be executed as described in the operating instructions.

Directly after termination of a process all safety and protection fittings must be placed back into place i.e. set in to function.

Before renewed operation all instructions in the section 'Putting into operation' must be executed.

2. General

The dosing pump R031 is a self-priming diaphragm pump. It consists of a housing with stepper motor and electronics and a dosing head with diaphragm and valves.

Excellent dosing features of the pump:

- Optimal intake even with degassing media, as the pump always works at full suction stroke volume.
- Continuous dosing, as the medium is sucked up with a short suction stroke, regardless of the current dosing flow, and dosed with the longest possible dosing stroke.

2.1 Warranty

A guarantee claim in accordance with our general terms of sale and delivery is only valid if the following requirements are fulfilled:

- The pump is used in accordance with the information within this manual.
- The pump is not dismantled or incorrectly handled.
- The maintenance is carried out by authorised and qualified personnel.
- Original spare parts are used for repairs during maintenance.

2.2 Applications

The pump is suitable for liquid, non-abrasive, non-flammable and non-combustible media strictly in accordance with the instructions in these installation and operating instructions. The stated limiting values as shown in the technical data must not be exceeded in any case.

Areas of Applikation

- Drinking water treatment
- Wastewater treatment
- Swimming pool water treatment
- Boiler water treatment
- CIP (Clean-In-Place)
- Cooling water treatment
- Process water treatment
- Wash plants
- Chemical industry
- Ultrafiltration processes and reverse osmosis
- Irrigation
- Paper and pulp industry
- Food and beverage industries

2.3 Improper operating methods

The operational safety of the pump is only guaranteed if it is used in accordance with section 2.2 *Applications*.

Caution

Frequent disengagement from the mains voltage, e.g. via a relay, can result in damage to the pump electronics and to the breakdown of the pump. The dosing accuracy is also reduced as a result of internal start procedures.'

**Do not control the pump via the mains voltage for dosing purposes!
Only use the 'External stop' function to start and stop the pump!**



Warning

Other applications or the operation of pumps in ambient and operation conditions, which are not approved, are considered improper and are not permitted. The Fink Chem + Tec OHG cannot be held liable for any damage resulting from incorrect use.



Warning
The pump is NOT approved for operation in potentially explosive areas!



Warning
A sunscreen is required for outdoor installation!

2.4 Nameplate

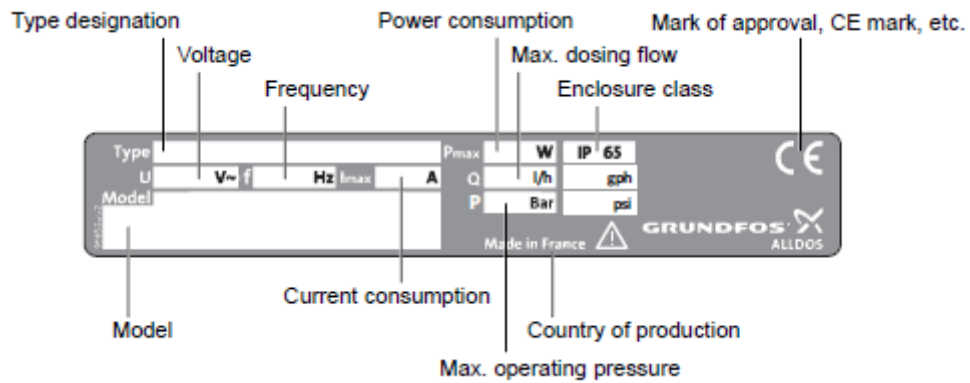


Fig. 1 Nameplate


2.5 Type key

The type key is used to identify the precise pump and is not used for configuration purposes.

Code	Example	R031	6-	10	P-	PP/	V/	C-	X-	3	1	U2U2	F	G
	Pump type													
	Max. flow [l/h]													
	Max. pressure [bar]													
	Control variant													
B	Basic													
P	B with pulse mode													
	Dosing head material													
PP	Polypropylene													
PVC	PVC (polyvinyl chloride) (PVC dosing heads only up to 10 bar)													
PV	PVDF (polyvinylidene fluoride)													
SS	Stainless steel DIN 1.4401													
PVC-P3	PVC with Plus ³													
	Gasket material													
E	EPDM													
V	FKM													
T	PTFE													
	Valve ball material													
C	Ceramic													
SS	Stainless steel DIN 1.4401													
	Control cube position													
X	No control cube													
	Voltage													
3	1 x 100-240 V, 50/60 Hz													
	Valve type													
1	Standard													
2	Spring-loaded (HV version)													
	Suction/discharge side connection													
U2U2	Hose, 4/6 mm, 6/9 mm, 6/12 mm, 9/12 mm													
U7U7	Hose 1/8" x 1/4"; 0.17" x 1/4"; 1/4" x 3/8"; 3/8" x 1/2"													
AA	Threaded Rp 1/4", female (stainless steel)													
VV	Threaded 1/4" NPT, female (stainless steel)													
XX	No connection													
	Installation set*													
I001	Hose, 4/6 mm (up to 7.5 l/h, 16 bar)													
I002	Hose, 9/12 mm (up to 60 l/h, 13 bar)													
I003	Hose 0.17" x 1/4" (up to 7.5 l/h, 16 bar)													
I004	Hose, 3/8" x 1/2" (up to 60 l/h, 10 bar)													
	Power plug													
F	EU (Schuko)													
B	USA, Canada													
G	UK													
I	Australia, New Zealand, Taiwan													
E	Switzerland													
J	Japan													
L	Argentina													
	Design													
G	Grundfos													

* including: 2 pump connections, foot valve, injection unit, 6 m PE discharge hose, 2 m PVC suction hose, 2 m PVC deaeration hose (4/6 mm).

2.6 Device overview

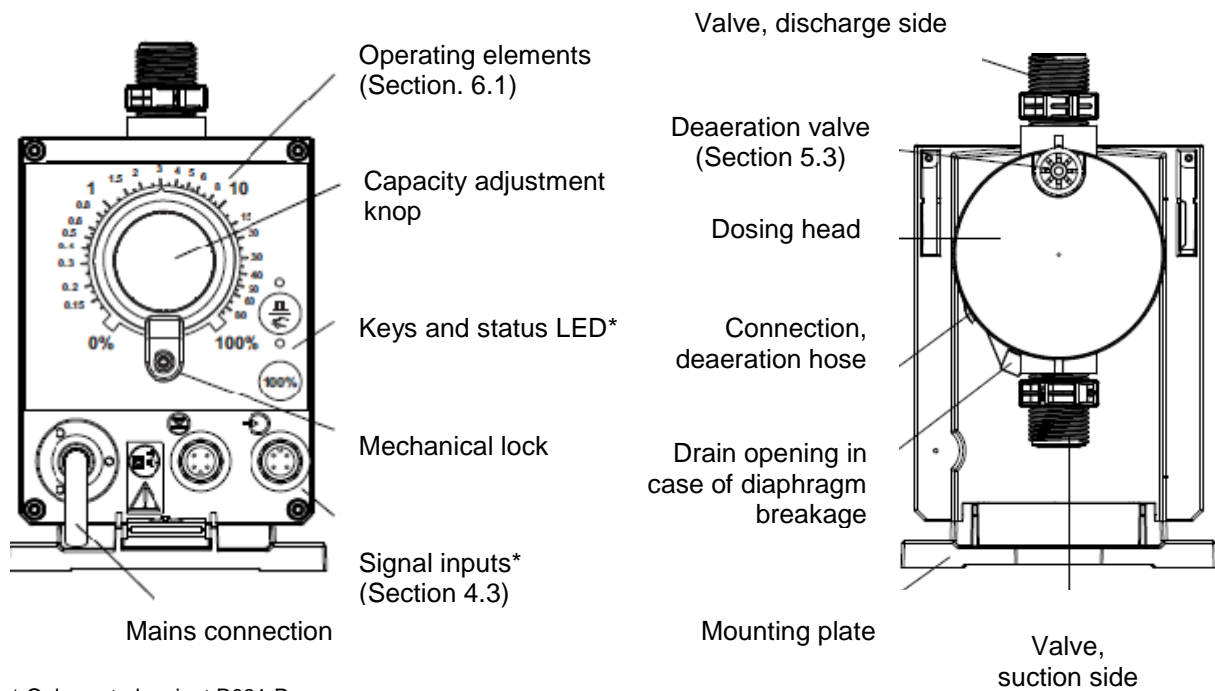

* Only control variant R031-P

Fig. 2 Overview

3. Technical data / dimensions

3.1 Technical data

Data		Pump type R031-		
		6-10	15-4	
Mechanical data	Turndown ration (setting range)	[1:X]	1000	1000
	Max. dosing flow	[l/h]	6,0	15,0
		[gph]	1,5	4,0
	Min. Dosing flow	[l/h]	0,006	0,015
		[gph]	0,0015	0,0040
	Max. operating pressure	[bar]	10	4
		[psi]	150	60
	Max. stroke frequency ¹⁾	[strokes/min]	140	180
	Stroke volume	[ml]	0,81	1,58
	Accuracy of repeatability	[%]	+/- 5	
	Max. suction lift during operation ²⁾	[m]	6	
	Max. suction lift when priming with wet valves ²⁾	[m]	2	3
	Min. pressure difference between suction and discharge side	[bar]	1	
	Max. pressure, suction side	[bar]	2	
	Max. viscosity with spring-loaded valves ³⁾	[mPas](=cP)	600	500
	Max. viscosity without spring-loaded valves ³⁾	[mPas](=cP)	50	
	Min. diameter of hose/pipe on suction/discharge side ²⁾⁴⁾	[mm]	4	6
	Min. diameter of hose/pipe on suction side for highly viscous media (HV) ⁴⁾	[mm]	9	
	Min. diameter of hose/pipe on discharge side for highly viscous media (HV) ⁴⁾	[mm]	9	
Max. media temperature	[°C]	45		
Min. media temperature	[°C]	-10		

Data			6-10	15-4
Mechanical data	Max. ambient temperature	[°C]	45	
	Min. ambient temperature	[°C]	0	
	Max. storage temperature	[°C]	70	
	Min. storage temperature	[°C]	-20	
Electrical data	Voltage	[V]	100-240 V, 50-60 Hz	
	Length of mains cable	[m]	1,5	
	Max. current consumption (100 V)	[A]	0,12	
	Max. current consumption (230 V)	[A]	0,05	
	Max. power consumption P ₁	[W]	12	
	Enclosure class		IP 65, Nema 4X	
	Electrical safety class		II	
Signal input ¹⁾	Max. load for level input		12 V, 5 mA	
	Max. load for pulse input		12 V, 5 mA	
	Max. load for external stop		12 V, 5 mA	
	Min. pulse length	[ms]	5	
	Max. pulse frequency	[Hz]	100	
	Max. resistance in level circuit	[Ω]	1000	
	Max. resistance in pulse circuit	[Ω]	1000	
Weight /size	Weight (PVC, PP, PVDF)	[kg]	2,4	
	Weight (stainless steel)	[kg]	3,2	
	Diaphragm diameter	[mm]	44	50
Sound pressure level	Max. sound pressure level	[dB(A)]	60	
Approvals			CE, CSA-US, NSF61, GHOST, C-Tick	

1) Applies to R031-P control variant

2) Data is based on measurements with water

3) Maximum suction lift: 1 m, dosing flow reduced (approx. 30%)

4) Length of suction line: 1.5 m / length of discharge line: 10 m (at max. viscosity)

3.2 Dimensions

The indicated dimensions are the same for all control variants of the R031 range.
The following drawing shows the R031-P control variant.

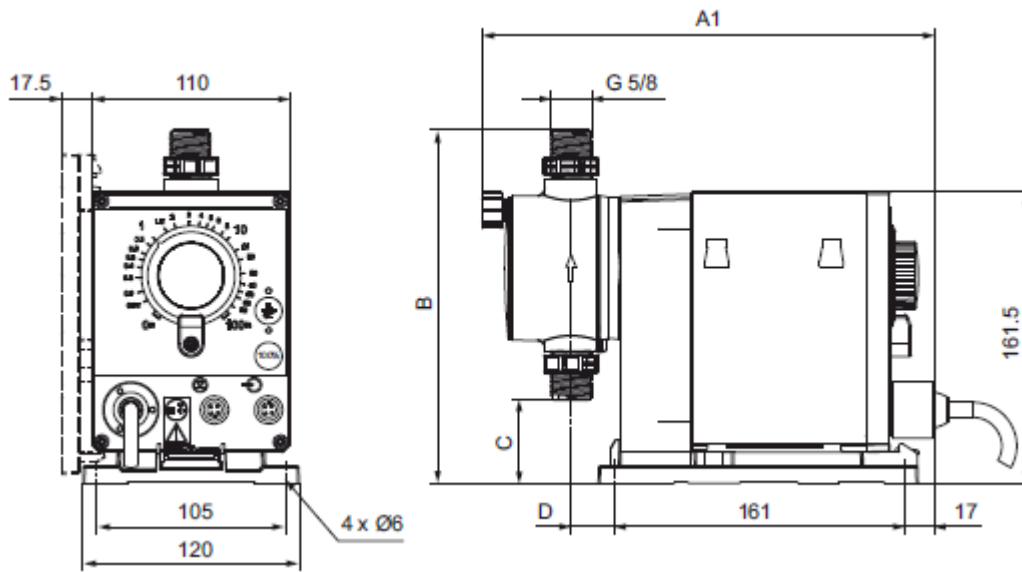


Fig.3 Dimensional drawing

Pump type	A1 (mm)	B (mm)	C (mm)	D (mm)
R031-6-10	251	196	46,5	24
R031-15-4	251	200,5	39,5	24

4. Assembly and installation

4.1 Pump assembly

The pump is delivered with a mounting plate. The mounting plate can be mounted vertically, e.g. on a wall, or horizontally, e.g. on a tank. It takes just a few quick steps to firmly secure the pump to the mounting plate by means of a slot mechanism.

The pump can easily be released from the mounting plate for maintenance.

4.1.1 Requirements

- The mounting surface must be stable and must not vibrate.
- Dosing must flow upwards vertically.

4.1.2 Align and install mounting plate

- **Vertical installation:** Mounting plate slot mechanism must be above.
- **Horizontal installation:** Mounting plate slot mechanism must be opposite the dosing head.
- The mounting plate can be used as a drill template, please see fig. 3 for drill hole distances.



Fig. 4 Locate mounting plate



Warning

Make sure that you do not damage any cables and lines during installation!

1. Indicate drill holes.
2. Drill holes.
3. Secure mounting plate using four screws, diameter 5 mm, to the wall, on the bracket or the tank.

4.1.3 Engage pump in mounting plate

1. Attach the pump to the mounting plate support clamps and slide under slight pressure until it engages.



Fig. 5 Engaging the pump

4.2 Hydraulic connection



Warning

Risk of chemical burns!

Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!

Caution

The dosing head may contain water from the factory check!

When dosing media which should not come into contact with water, another medium must be dosed beforehand!

Caution

Faultless function can only be guaranteed in conjunction with lines supplied by Fink Chem + Tec OHG

Caution

The lines used must comply with the pressure limits as per section 3.1 Technical data!

Important information on installation

- Observe suction lift and hose diameter, see section 3.1 Technical data.
- Shorten hoses at right angles.
- Ensure that there are no loops or kinks in the hoses.
- Keep suction line as short as possible.
- Route suction line up towards the suction valve.
- Installing a filter in the suction line protects the entire installation against dirt and reduces the risk of leakage.

Hose connection procedure

1. Push union nut and tensioning ring across hose.
2. Push cone part fully into the hose, see fig. 6.
3. Attach cone part with hose to the corresponding pump valve.
4. Tighten union nuts manually
 - do not use tools!
5. Tighten up union nuts after 2-5 operating hours, if using PTFE gaskets!
6. Attach deaeration hose to the corresponding connection (see fig. 2) and run into a container or a collecting tray.

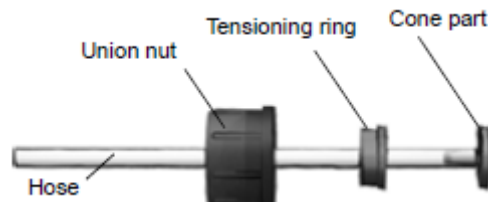


Fig. 6 Hydraulic connection

Note

Pressure differential between suction and discharge side must be at least 1 bar/14.5 psi!

Caution

Tighten up the dosing head screws once before commissioning and after 2-5 operating hours at 3 Nm.

Installation example

The pump offers various installation options. In the picture below, the pump is installed in conjunction with a suction line, level switch and multifunction valve on a Fink Chem + Tec GmbH & Co. KG tank.

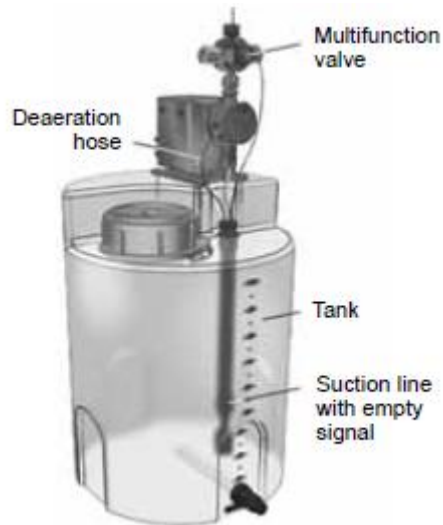


Fig. 7 Installation example

4.3 Electrical connection

Mains connection



Warning

The enclosure class (IP65/Nema 4X) is only guaranteed if lugs or protective caps or correctly installed!



Warning

The pump can start automatically when the mains voltage is switched on!
Do not manipulate mains plug or cable!

The pump is supplied with assembled mains cable and plug

1. Set capacity adjustment knob to 0% (see 6.1 *Operating elements*).
2. Connect the mains plug with the mains socket.

Signal connections

Applies to R031-P control variant.

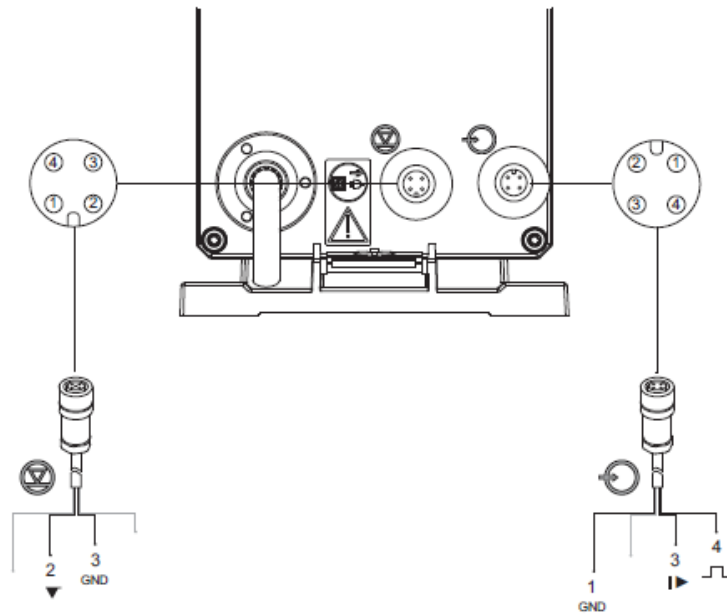


Fig. 8 Wiring diagram of the electrical connections (R031-P)

External stop and pulse input

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
External stop	GND		X		Pulse
Pulse	GND			X	Pulse

Level signals: empty signal

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Empty signal		X	GND		Pulse

5. Commissioning

5.1 General notes



Warning

Suction and discharge hoses must be connected correctly!

The deaeration hose must be connected correctly and inserted into a suitable tank!

Caution

Tighten up the dosing head screws once before commissioning and after 2-+5 operating hours at 3 Nm.

5.2 Check before commissioning

- Check that the rated voltage indicated on the nameplate complies with the local conditions.
- Check that all connections are assembled correctly. Tighten connections, if necessary.
- Check that the dosing head screws are tightened with the indicated torque (3 Nm). Tighten dosing head screws, if necessary.
- Check that all electrical cables and plugs are connected correctly.

5.3 Start and deaerate the pump

- Connect mains supply (see 4.3 *Electrical connection*).
 - Open the deaeration screw by approximately half a turn.
 - *R031-P Control variant*: Press the deaeration key (1200%) and hold it down, until liquid flows out of the deaeration hose continuously and without any bubbles
 - *R031-B Control variant*: Turn the capacity adjustment knob to 100% and wait, until liquid flows out of the deaeration hose continuously and without any bubbles. Then set the capacity adjustment knob back to 0%.
 - Close the deaeration screw.
- The pump is deaerated.

6. Operation

6.1 Operating elements

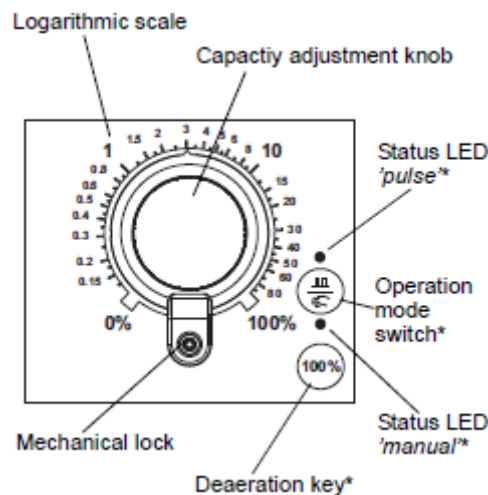


Fig. 9 Operating elements

Capacity adjustment knob

The capacity adjustment knob is used to set the capacity in percent of the maximum dosing flow of the pump. Due to the logarithmical increase of the percent values, even small dosing capacities can be set accurately.

Mechanical lock

The mechanical lock protects the set dosing capacity against unauthorised manipulation. For locking, tighten the screw until the adjustment knob cannot be turned anymore.

Keys and LEDs

* Applies to R031-P control variant.

When pressing and holding down the deaeration key, the pump doses at 100% for a certain time. The deaeration key can be used e.g. for deaeration.

The operation mode switch is used to change between the 'Manual' and 'Pulse' modes (see section 6.2.3). According to the selected operation mode, the respective status LED is active ('pulse' = LED above switch; 'manual' = LED below switch).

The status LEDs indicate the following operating statuses and faults:

LED colour	Pump status / fault
green (flashing)	stop
green	running
yellow	standby (external stop)
red	empty signal (alarm)
red (flashing)	motor blocked (alarm)

6.2 Operation modes

Following operation modes are available:

- **Manual**, see section 6.2.1
- **Pulse***, see section 6.2.2

**Applies to R031-P control variant.*

6.2.1 Manual

In this operation mode, the pump doses constantly the dosing quantity set by adjustment knob.

The setting range depends on the pump type:

Type	Setting range (l/h)
R031-6-10	6 ml/h – 6 l/h
R031-15-4	15 ml/h – 15 l/h

6.2.2 Pulse

Applies to R031-P control variant.

In this operation mode, the pump doses the set dosing volume for each incoming (potential-free) pulse, e.g. from a water meter. There is no direct connection between incoming pulses and dosing strokes. The pump automatically calculates the optimum stroke frequency for dosing the set volume per pulse.

The calculation is based on:

- the frequency of external pulses
- the set stroke volume in percent.

The dosing quantity per pulse is set to a value between 0.1% and 100% of the stroke volume using the adjustment knob.

The setting range depends on the pump type:

Type	Setting range
R031-6-10	0,8 µl – 0,81 ml
R031-15-4	1,6 µl – 1,58 ml

The frequency of incoming pulses is multiplied by the set dosing volume. If the pump receives more pulses than it can process at the maximum dosing flow, it runs at the maximum stroke frequency in continuous operation. Excess pulses will be ignored if the memory function is not enabled.

6.2.3 Change operation modes

Applies to R031-P control variant.

1. Set adjustment knob to 0%
2. Connect mains supply (see section 4.3 *Electrical connection*).
3. Hold down the operation mode switch for at least 5 seconds.

The new operation mode is saved.

6.3 Inputs

Applies to R031-P control variant.

6.3.1 External stop

The pump can be stopped via an external pulse, e.g. from a control room. When activating the external stop pulse, the pump switches from the operational state '*Running*' into the operational state '*Standby*'. According to the selected operation mode, the respective LED flashes yellow.

Caution Frequent disengagement from the mains voltage, e.g. via a relay, can result in damage to the pump electronics and to the breakdown of the pump. The dosing accuracy is also reduced as a result of internal start procedures.
Do not control the pump via the mains voltage for dosing purposes!
Only use the '*External stop*' function to start and stop the pump!

6.3.2 Empty signal

In order to monitor the filling level in the tank, a one-level sensor (empty signal) can be connected to the pump.

The pump reacts to the signal as follows:

- the active status LED flashes red
- the pump stops.

Caution When the tank is filled up again, the pump restarts automatically!

6.3.3 Change contact type

The signal inputs (empty signal and external stop) are configured at the factory as normally open (NO) contacts. They can be re-configured as normally closed (NC) contacts. The re-configuration is always made for both inputs.

1. Set adjustment knob to 0%.
2. Connect mains supply (see section 4.3 *Electrical connection*).
3. Press deaeration key and operation mode key simultaneously and hold them down for at least 2 seconds.

The new contact type is saved.

7. Service

In order to ensure a long service life and dosing accuracy, wearing parts such as diaphragms and valves must be regularly checked for signs of wear. Where necessary, replace worn parts with original spare parts made from suitable materials.

Should you have any questions, please contact with us.



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 2).

Take suitable precautions to prevent harm to health and damage to property caused by escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

7.1 Service intervals

Interval	Task
Every day	Check, if liquid leaks from dosing head, drain opening or valves (see fig. 2). If necessary, tighten dosing head screws (3Nm), valves and cap nuts, or perform service (see 7.2 Perform service).
Every 2 years or 8000 operating hours	Replace diaphragm and valves (see 7.2 Perform service)

7.2 Perform service

Only spare parts and accessories from Fink Chem + Tec OHG should be used for maintenance. The usage of non-original spare parts and accessories renders any liability for resulting damages null and void.

I



Warning

When dosing dangerous media, observe corresponding precautions in the safety data sheets!

Risk of chemical burns!


Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!

Do not allow any chemicals to leak from the pump. Collect and dispose of all chemicals correctly!

Caution

Before any work to the pump, the pump must be disconnected from the mains. The system must be pressureless!

7.2.1 Dosing head overview

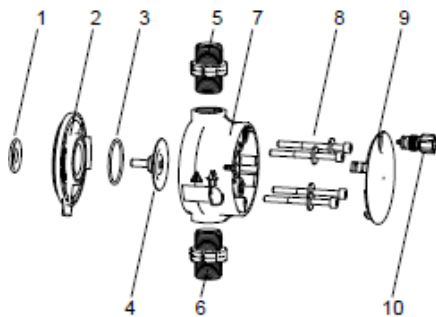

1	Safety diaphragm
2	Flange
3	O-ring
4	Diaphragm
5	Valve on discharge side
6	Valve on suction side
7	Dosing head
8	Screws with discs
9	Cover
10	Deaeration valve

Fig. 10 Dosing head, exploded view

7.2.2 Dismantling the diaphragm and valves

1. Make system pressureless.
2. Empty the dosing head before maintenance and flush it if necessary.
3. Set adjustment knob to 0%.
4. Switch off mains supply.
5. Take suitable steps to ensure that the returning liquid is safely collected.
6. Dismantle suction, pressure and deaeration hoses.
7. Dismantle valves on suction and discharge side (5, 6).
8. Remove the cover (9).
9. Loosen screws (8) on the dosing head (7) and remove the screws and discs.
10. Remove the dosing head (7).
11. Unscrew diaphragm (4) counter-clockwise and remove with flange (2)

7.2.3 Reassembling the diaphragm and valves

1. Attach flange (2) correctly and screw on new diaphragm (4) clockwise.
- Make sure that the O-ring (3) is seated correctly!
2. Connect / switch on mains supply.
3. Turn the adjustment knob slowly to bring the diaphragm into its serviced position 'inside' (end of suction phase, diaphragm retracted). Set adjustment knob back to 0%
4. Switch off mains supply again.
5. Attach the dosing head (7).
6. Install screws with discs (8) and cross-tighten.
- Torque: 3 Nm.
7. Attach the cover (9)
8. Install new valves (5, 6).
- Do not interchange valves and pay attention to direction of arrow.
9. Connect suction, pressure and deaeration hoses (see section 4.2 *Hydraulic connection*).
10. Deaerate dosing pump (see section 5.3 Start and deaerate the pump).
11. Please observe the notes on commissioning in section 5. *Commissioning!*

7.3 Repairs



Warning

The pump housing must only be opened by personnel authorised by Fink Chem + Tec OHG!

Repairs must only be carried out by authorised and qualified personnel!

Switch off the pump and disconnect it from the voltage supply before carrying out maintenance work and repairs!

After consulting Fink Chem + Tec OHG, please send the pump, together with the safety declaration completed by a specialist, to Fink Chem + Tec OHG. The safety declaration can be found at the end of these instructions. It must be copied, completed and attached to the pump.

Caution

If the pump has been used to dose toxic liquids or liquids hazardous to health, the pump must be cleaned prior to dispatch!

If the above requirements are not met, the Fink Chem + Tec OHG may refuse to accept delivery of the pump. The shipping costs will be charged to the sender.

8. Faults

8.1 Indication of faults

Depending on the selected operation mode, the pump indicates the following faults with its LEDs:

LED colour	Fault	Remedy
red	empty signal	<ul style="list-style-type: none"> • fill tank • check contact type • (see section 6.3.3).
red (flashing)	motor blocked	<ul style="list-style-type: none"> • reduce backpressure. • have gear repaired, if necessary.

For further faults, please see 8.2 *List of faults*.

8.2 List of faults

Fault	Possible cause	Possible remedy
1. Dosing flow too high	a) Inlet pressure greater than backpressure	<ul style="list-style-type: none"> • Install additional spring loaded valve (approx. 3 bar) on the discharge side. • Increase pressure differential
2. No dosing flow or dosing flow too low	a) Air in dosing head	Deaerate the pump.
	b) Faulty diaphragm	Change the diaphragm <i>(see section 7.2 Perform service).</i>
	c) Leakage/fracture in lines	Check and repair lines.
	d) Valves leaking or blocked	Check and clean valves.
	e) Valves installed incorrectly	<ul style="list-style-type: none"> • Check that the arrow on the valve housing is pointing in the direction of flow. • Check whether all O-rings are installed correctly.
	f) Blocked suction line	<ul style="list-style-type: none"> • Clean suction line/install filter.
	g) Suction lift too high	<ul style="list-style-type: none"> • Reduce suction lift. • Install priming aid.
	h) Viscosity too high	<ul style="list-style-type: none"> • Use hose with larger diameter. • Install spring-loaded valve on the discharge side.
	i) Deaeration valve open	<ul style="list-style-type: none"> • Close the deaeration valve.
3. Irregular dosing	a) Valves leaking or blocked	Tighten up valves, replace valves if necessary <i>(see section 7.2 Perform service)</i>
	b) Backpressure fluctuations	Keep backpressure constant.
4. Liquid escaping from the discharge opening on the flange	a) Faulty diaphragm	Change the diaphragm <i>(see 7.2 Perform service).</i>
5. Liquid escaping	a) Dosing head screws not screwed in as far as they will go	Tighten up screws <i>(see section 4.2 Hydraulic connection).</i>
	b) Valves not screwed in as far as they will go	Tighten up valves/union nuts <i>(see section 4.2 Hydraulic connection).</i>
6. Pump not sucking in	a) Suction lift too high	Reduce suction lift; if necessary, provide positive inlet pressure.
	b) Backpressure too high	Open the deaeration valve.
	c) Soiled valves	Flush system, replace valves if necessary <i>(see section 7.2 Perform service).</i>

9. Disposal

This product and all its associated parts must be disposed of in an environmentally friendly manner. Use appropriate waste collection services. If there is no such facility or the facility refuses to accept these materials used in the product, the product can be sent to the Fink Chem + Tec OHG.

Appendix


Safety declaration

Please copy, fill in and sign this sheet and attach it to the pump returned for service.

Product type (nameplate) _____
 Model- number (nameplate) _____
 Dosing medium _____

Fault description

Please make a circle around the damaged parts.
 In the case of an electrical or functional fault, please mark the cabinet.

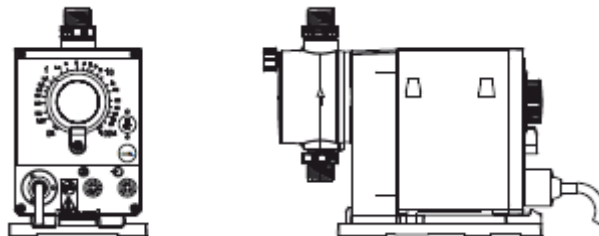

Please describe the error / cause of the error in brief.

We hereby declare that the pump has been cleaned and is completely free from chemical, biological and radioactive substances.

Date, signature and Company stamp

© 2014 Fink Chem + Tec OHG

The texts, images and examples in this manual are carefully compiled. Fink Chem + Tec OHG is not liable for possible remaining incorrect details and following consequences or breach of other third party rights neither legal responsibility nor other liability. We are thankful for any notifications or improvement suggestions.

The material, Soft and Hardware terms and names mentioned in this manual are usually registered trademarks and underlie the legal regulations.

The manual protected by copyright. All rights reserved. No part of this manual may be reproduced by photo copy, microfilm or other means or transferred to machines, especially data processing equipment, in the appropriate language. Presentation by submission in lectures, radio and television is allowed only with our written consent.

EG - Declaration of Conformity

Machinery Directive 2006/42/EG, II 1, A

Membrane Metering Pumps

Ritmo 031-15-4 PTFE

Manufacturer Fink Chem+Tec OHG
Hofstraße 9
D-78073 Bad Dürkheim

We declare that this delivered R 031/DDE Metering Pump and in all versions are in conformity with the following standards or standardized documents according to the provisions of the directives of the EC state members.

- Machinery Directive (2006/42/EG).
Standards used:
EN 809: 1998
EN ISO 12100-1+A1: 2009
EN ISO 12100-2+A1: 2009
- EMC Directive (2004/108/EG).
Standards used:
EN 61000-6-2: 2005,
EN 61000-6-4: 2007
- Low Voltage Directive (2006/95/EG).
Standard used: EN 60204-1+A1: 2009
- Electrical equipment applicated within specified voltage ranges
Norm EN 61 010 -1 und EN 61 010-2-010/A1

Person authorised to compile technical file and empowered to sign the EC declaration of conformity.

Manufacturer/Supplier
Grundfos/Fink Chem+Tec GmbH & Co. KG

A. Fink

Date
29.07.2014



Operating Instructions

Membrane Metering Pump

Ritmo 032-xx

FINK Chem + Tec GmbH & Co. KG

Maybachstraße 11

70771 Leinfelden-Echterdingen

Tel. 0711/99755427

Fax 0711/99755428

info@finkct.de

www.finkct.de

Contents

Index of contents

1.	Safety instructions	4
1.1	Identification of safety instructions in these instructions	4
1.2	Qualification and training of personnel	4
1.3	Safety instructions for the operator/ user	4
1.4	Safety of the system in the event of a failure in the dosing pump	4
1.5	Dosing chemicals	5
1.6	Safety instructions for service, inspection and mounting	5
2.	General	6
2.1	Applications	6
2.2	Improper operating methods	6
2.3	Warranty	6
2.4	Nameplate	7
2.5	Type key	8
2.6	Device overview	9
3.	Technical data / dimensions	10
3.1	Technical data	10, 11
3.2	Dimensions	12
4.	Assembly and installation	13
4.1	Pump assembly	13
4.1.1	Requirements	13
4.1.2	Align and install mounting plate	13
4.1.3	Engage pump in mounting plate	13
4.1.4	Adjust control cube position	14
4.2	Hydraulic connection	14, 15
4.3	Electrical connection	16
5.	Commissioning	18
5.1	Setting the menu language	18
5.2	Deaerating the pump	19
5.3	Calibrating the pump	19, 20
6.	Operation	21
6.1	Operating elements	21
6.2	Display and symbols	21
6.2.1	Navigation	21
6.2.2	Operating states	21
6.2.3	Sleep mode (energy-saving mode)	22
6.2.4	Overview of display symbols	22
6.3	Main menus	23
6.3.1	Operation	23
6.3.2	Info	23
6.3.3	Alarm	23
6.3.4	Setup	24
6.4	Operation modes	24
6.4.1	Manual	24
6.4.2	Pulse	24, 25
6.4.3	Analog 0/4 – 20mA	25
6.5	SlowMode	26
6.6	Key lock	26
6.7	Display Setup	26
6.7.1	Units	27
6.7.2	Additional display	27

6.8	Inputs/outputs	27
6.8.1	Relay outputs	28
6.8.2	External stop	28
6.8.3	Empty and low-level signals	28
6.9	Basic settings	28
7.	Service	29
7.1	Service system	29
7.2	Perform service	30
7.2.1	Dosing head overview	30
7.2.2	Dismantling the diaphragm and valves	30
7.2.3	Reassembling the diaphragm and valves	30
7.3	Resetting the service system	31
7.4	Repairs	31
8.	Faults	31
8.1	List of faults	32
8.1.1	Faults with error message	32
8.1.2	General faults	33
9.	Disposal	33
10.	Safety declaration	34
11.	EG- Declaration of Conformity	35

1. Safety instructions

These installation and operating instructions contain general instructions that must be observed during installation, operation and maintenance of the pump.

It must therefore be read by the installation engineer and the relevant qualified operator prior to installation and start-up, and must be available at the installation location at all times.

Apart from these general safety instructions there are further special instructions in other sections to which attention must be given.

The instructions mounted directly on the metering pump must be heeded and always kept in a visible condition.

Besides the general safety instructions the operator must consider the existing national regulations for accident prevention as well as the internal working, company, and safety regulations.

1.1 Identification of safety instructions in these instructions

The safety instructions are identified by the following symbols:



Warning

If these safety instructions are not observed, it may result in personal injury!



If these safety instructions are not observed, it may result in malfunction or damage to the equipment!



Notes or instructions that make the job easier and ensure safe operation.

1.2 Qualification and training of personnel

The personnel responsible for the installation, operation and service must be appropriately qualified for these tasks. Areas of responsibility, levels of authority and the supervision of the personnel must be precisely defined by the operator. If necessary, the personnel must be trained appropriately.

Risks of not observing the safety instructions

Non-observance of the safety instructions may have dangerous consequences for the personnel, the environment and the pump and may result in the loss of any claims for damages.

It may lead to the following hazards:

- Personal injury from exposure to electrical, mechanical and chemical influences.
- Damage to the environment and personal injury from leakage of harmful substances.

1.3 Safety instructions for the operator/ user

The safety instructions described in these instructions, existing national regulations on health protection, environmental protection and for accident prevention and any internal working, operating and safety regulations of the operator must be observed.

Information attached to the pump must be observed.

Leakages of dangerous substances must be disposed of in a way that is not harmful to the personnel or the environment.

Damage caused by electrical energy must be prevented, see the regulations of the local electricity supply company and the regulations VDE.



Before starting work on the pump, the pump must be disconnected from the mains. The system must be pressureless!

Only original accessories and original spare parts should be used. Using other parts can result in exemption from liability for any resulting consequences.

An existing guards for moving parts must not be removed while the system is in operation.

1.4 Safety of the system in the event of a failure in the dosing pump

The dosing pump was designed according to the latest technologies and is carefully manufactured and tested.

If it fails regardless of this, the safety of the overall system must be ensured. Use the relevant monitoring and control functions for this.

Caution

Make sure that any chemicals that are released from the pump or any damaged lines do not cause damage to system parts and buildings. The installation of leak monitoring solutions and drip trays is recommended.

1.5 Dosing chemicals



Warning

Before switching the supply voltage back on, the dosing lines must be connected in such a way that any chemicals in the dosing head cannot spray about and put people at risk.

The dosing medium is pressurized and can be harmful to health and the environment.



Warning

When working with chemicals, the accident prevention regulations applicable at the installation site should be applied (e.g. wearing protective clothing).

Observe the chemical manufacturer's safety data sheets and safety instructions when handling chemicals!



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 3).

Take suitable precautions to prevent harm to health and damage to property from escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

Changing the diaphragm, see section 7. Service.

Caution

A deaeration hose, which is routed into a container, e.g. a drip tray, must be connected to the deaeration valve.

Caution

The dosing medium must be in liquid aggregate state!

Observe the freezing and boiling points of the dosing medium!

Caution

The resistance of the parts that come into contact with the dosing medium, such as the dosing head, valve ball, gaskets and lines, depends on the medium, media temperature and operating pressure.

Ensure that parts in contact with the dosing medium are resistant to the dosing medium under operation conditions.

Should you have any questions regarding the material resistance and suitability of the pump for specific dosing media, please contact with Fink Chem + Tec OHG

1.6 Safety instructions for service, inspection and mounting

The organization is responsible for execution of all service, inspection and mounting work is only done through authorized qualified persons who are instructed with an adequate study of the mounting and operating instructions.

Fundamentally, all work on the metering pump is executed only when the pump is not running. The stopping procedure of the pump must be executed as described in the operating instructions.

Directly after termination of a process all safety and protection fittings must be placed back into place i.e. set in to function.

Before renewed operation all instructions in the section 'Putting into operation' must be executed.

2. General

The dosing pump R032 is a self-priming diaphragm pump. It consists of a housing with stepper motor and electronics, a dosing head with diaphragm and valves and the control cube.

Excellent dosing features of the pump:

- Optimal intake even with degassing media, as the pump always works at full suction stroke volume.
- Continuous dosing, as the medium is sucked up with a short suction stroke, regardless of the current dosing flow, and dosed with the longest possible dosing stroke.

2.1 Applications

The pump is suitable for liquid, non-abrasive, non-flammable and non-combustible media strictly in accordance with the instructions in these installation and operating instructions. The stated limiting values as shown in the technical data must not be exceeded in any case.

Areas of Applikation

- Drinking water treatment
- Wastewater treatment
- Swimming pool water treatment
- Boiler water treatment
- CIP (Clean-In-Place)
- Cooling water treatment
- Process water treatment
- Wash plants
- Chemical industry
- Ultrafiltration processes and reverse osmosis
- Irrigation
- Paper and pulp industry
- Food and beverage industries

2.2 Improper operating methods

The operational safety of the pump is only guaranteed if it is used in accordance with section 2.1 Applications.



Warning

Other applications or the operation of pumps in ambient and operation conditions, which are not approved, are considered improper and are not permitted. The Fink Chem + Tec OHG cannot be held liable for any damage resulting from incorrect use.



Warning

The pump is NOT approved for operation in potentially explosive areas!



Warning

A sunscreen is required for outdoor installation!

2.3 Warranty

A guarantee claim in accordance with our general terms of sale and delivery is only valid if the following requirements are fulfilled:

- The pump is used in accordance with the information within this manual.
- The pump is not dismantled or incorrectly handled.

- The maintenance is carried out by authorised and qualified personnel.
- Original spare parts are used for repairs during maintenance.

2.4 Nameplate

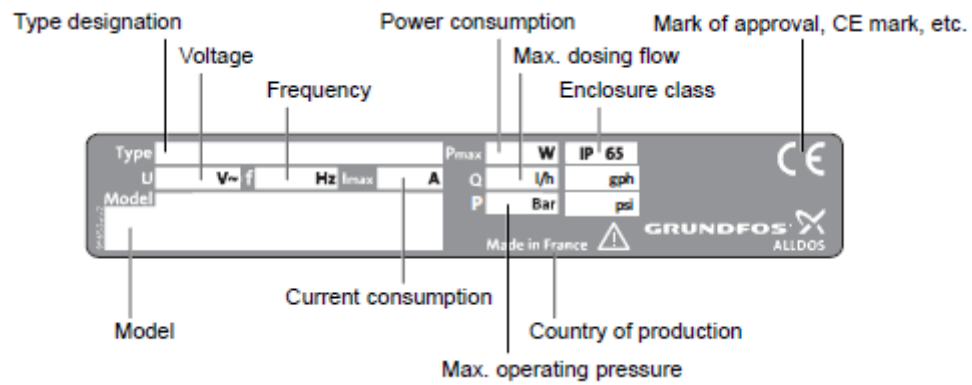


Fig. 1 Nameplate

2.5 Type key

The type key is used to identify the precise pump and is not used for configuration purposes.

Code	Example	R032	6-	10	AR-	PP/	V/	C-	F-	3	1	U2U2	F	G
	Pump type													
	Max. flow [l/h]													
	Max. pressure [bar]													
	Control variant													
A	Standard													
AR	A with alarm relay and analog input													
	Dosing head material													
PP	Polypropylene													
PVC	PVC (polyvinyl chloride) (only up to 10 bar)													
PV	PVDF (polyvinylidene fluoride)													
SS	Stainless steel DIN 1.4401													
PVC-P3	PVC with Plus ³													
	Gasket material													
E	EPDM													
V	FKM													
T	PTFE													
	Valve ball material													
C	Ceramic													
SS	Stainless steel DIN 1.4401													
	Control cube position													
F	Front-mounted (can be changed to the right or left)													
	Voltage													
3	1 x 100-240 V, 50/60 Hz													
I	24-48 VDC**													
	Valve type													
1	Standard													
2	Spring-loaded (HV version)													
	Suction/discharge side connection													
U2U2	Hose, 4/8 mm, 6/8 mm, 8/12 mm, 9/12 mm													
U7U7	Hose 1/8" x 1/4"; 0.17" x 1/4"; 1/4" x 3/8"; 3/8" x 1/2"													
AA	Threaded Rp 1/4", female (stainless steel)													
VV	Threaded 1/4" NPT, female (stainless steel)													
XX	No connection													
	Installation set*													
I001	Hose, 4/8 mm (up to 7.5 l/h, 16 bar)													
I002	Hose, 9/12 mm (up to 60 l/h, 13 bar)													
I003	Hose 0.17" x 1/4" (up to 7.5 l/h, 16 bar)													
I004	Hose, 3/8" x 1/2" (up to 60 l/h, 10 bar)													
	Power plug													
F	EU (Schuko)													
B	USA, Canada													
G	UK													
I	Australia, New Zealand, Taiwan													
E	Switzerland													
J	Japan													
L	Argentina													
X	No plug (only 24-48 VDC)**													
	Design													
G	Grundfos													

* including: 2 pump connections, foot valve, injection unit, 6 m PE discharge hose, 2 m PVC suction hose, 2 m PVC deaeration hose (4/6 mm)

2.6 Device overview

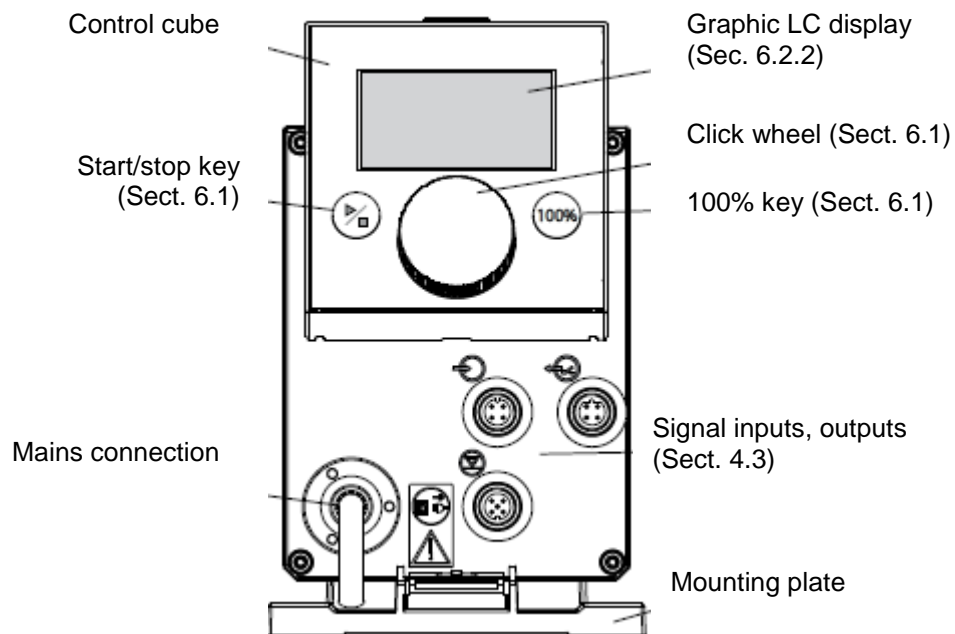


Fig. 2 Front view of the pump

Valve, discharge side

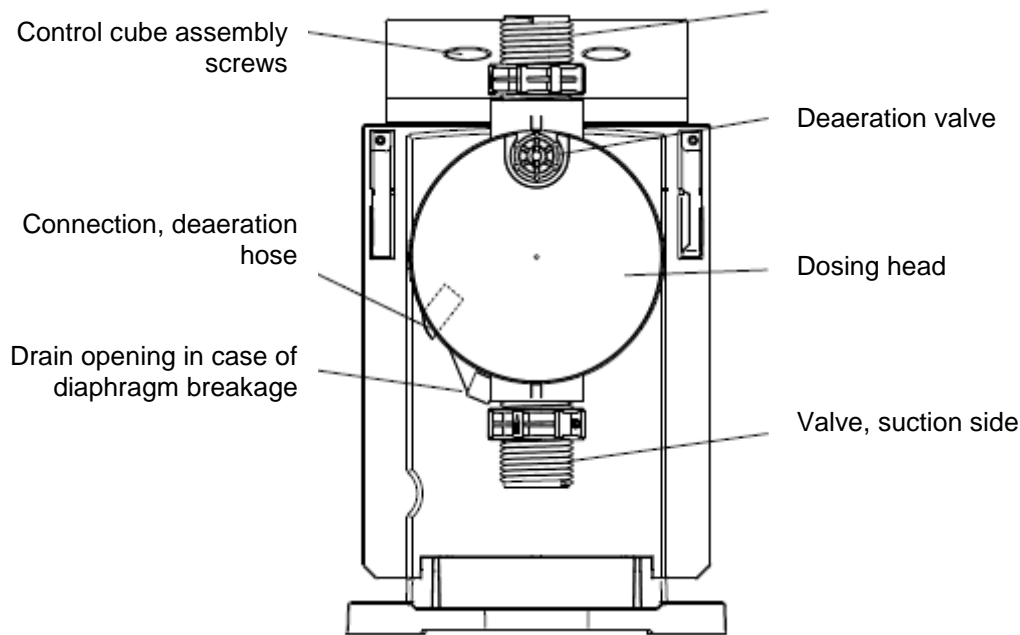


Fig. 3 Rear view of the pump

3. Technical data / dimensions

3.1 Technical data

Data		Pump type R032-			
		6-10	9-7	15-4	
Mechanical data	Turndown ration (setting range)	[1:X]	1000	1000	1000
	Max. dosing flow	[l/h]	6,0	9,0	15,0
		[gph]	1,5	2,4	4,0
	Max. dosing flow with SlowMode 50 %	[l/h]	3,00	4,50	7,50
		[gph]	0,75	1,20	2,00
	Max. dosing flow with SlowMode 25%	[l/h]	1,50	2,25	3,75
		[gph]	0,38	0,60	1,00
	Min. dosing flow	[l/h]	0,0060	0,0090	0,0150
		[gph]	0,0015	0,0024	0,0040
	Max. operating pressure	[bar]	10	7	4
		[psi]	150	100	60
	Max. stroke frequency ¹⁾	[Hübe/min]	140	200	180
	Stroke volume	[ml]	0,81	0,84	1,58
	Accuracy of repeatability	[%]	+/- 1		
Max. suction lift during operation ²⁾	[m]	6			
Max. suction lift when priming with wet valves ²⁾	[m]	2	2	3	
Min. pressure difference between suction and discharge side	[bar]	1			
Max. pressure, suction side	[bar]	2			
Max. viscosity in SlowMode 25% with spring-	[mPas](=cP)	2500	2000	2000	

	loades valves ³⁾				
	Max. viscosity in SlowMode 50% with spring-loaded valves ³⁾	[mPas](=cP)	1800	1300	1300
	Max. viscosity without SlowMode with spring-loaded valves ³⁾	[mPas](=cP)	600	500	500
	Max. viscosity without spring-loaded valves ³⁾	[mPas](=cP)	50	50	300
	Min. diameter of hose/pipe on suction/discharge side ²⁾⁴⁾	[mm]	4	6	6
	Min. diameter of hose/pipe on suction side for highly viscous media (HV) ⁴⁾	[mm]	9		
	Min. diameter of hose/pipe on discharge side for highly viscous media (HV) ⁴⁾	[mm]	9		
	Max. media temperature	[°C]	45		
	Min. media temperature	[°C]	-10		
	Max. ambient temperature	[°C]	45		
	Min. ambient temperature	[°C]	0		
	Max. storage temperature	[°C]	70		
	Min. storage temperature	[°C]	-20		
Electrical data	Voltage	[V]	100-240 V, 50-60 Hz		
	Length of mains cable	[m]	1,5		
	Max. current consumption (100 V)	[A]	0,14		
	Max. current consumption (230 V)	[A]	0,06		
	Max. power consumption P ₁	[W]	14		
	Housing enclosure class		IP 65, Nema 4X		
	Electrical safety class		II		
Signal input ¹⁾	Max. load for level input		12 V, 5 mA		
	Max. load for pulse input		12 V, 5 mA		
	Max. load for level input, external stop		12 V, 5 mA		
	Min. pulse length	[ms]	5		
	Max. pulse frequency	[Hz]	100		
	Impedance at 0/4-20 mA analog input	[Ω]	15		
	Max. resistance in level circuit	[Ω]	1000		
	Max. resistance in pulse circuit	[Ω]	1000		
Data			6-10	9-7	15-4
Signal output	Max. ohmic load on relay output	[A]	0,5		
	Max. voltage on relay output	[V]	30 VDC/ 30 VAC		
	Impedance at 0/4-20 mA analog output	[Ω]	500		
Weight/ size	Weight (PVC, PP, PVDF)	[kg]	2,4		
	Weight (stainless steel)	[kg]	3,2		
	Diaphragm diameter	[mm]	44		50
Sound pressure level	Max. sound pressure level	[dB(A)]	60		
Approvals			CE, CSA-US, NSF61, GHOST, C-Tick		

1) The maximum stroke frequency varies depending on calibration

2) Data is based on measurements with water

3) Maximum suction lift: 1 m, dosing flow reduced (approx. 30%)

4) Length of suction line: 1.5 m / length of discharge line: 10 m (at max. viscosity)

3.2 Dimensions

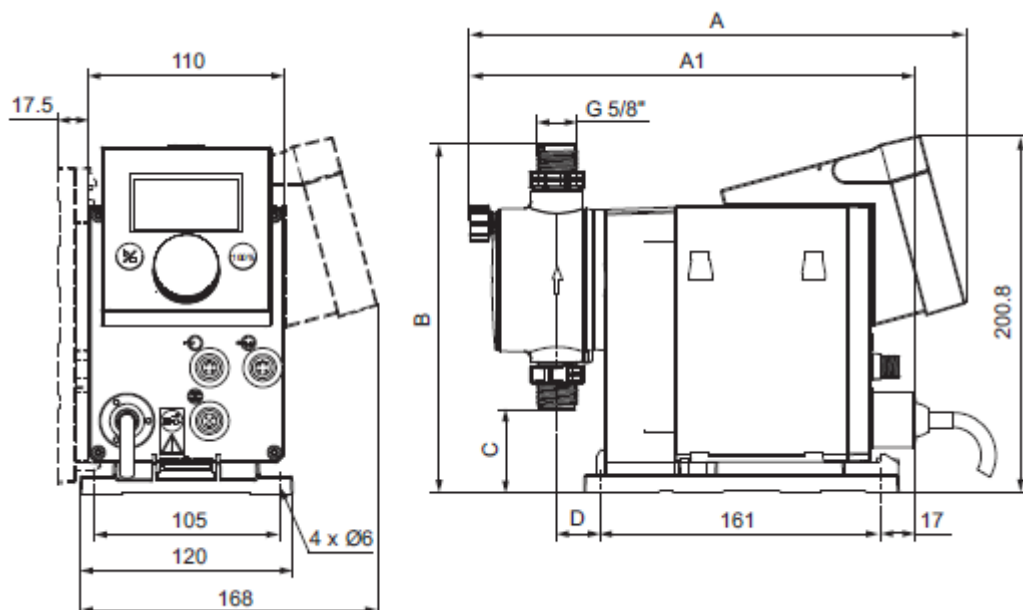


Fig.4 Dimensional drawing

Pump type	A (mm)	A1 (mm)	B (mm)	C (mm)	D (mm)
R032-6-10	280	251	196	46,5	24
R032-9-7	280	251	196	46,5	24
R032-15-4	280	251	200,5	39,5	24

4. Assembly and installation

4.1 Pump assembly

The pump is delivered with a mounting plate. The mounting plate can be mounted vertically, e.g. on a wall, or horizontally, e.g. on a tank. It takes just a few quick steps to firmly secure the pump to the mounting plate by means of a slot mechanism.

The pump can easily be released from the mounting plate for maintenance.

4.1.1 Requirements

- The mounting surface must be stable and must not vibrate.
- Dosing must flow upwards vertically.

4.1.2 Align and install mounting plate

- **Vertical installation:** Mounting plate slot mechanism must be above.
- **Horizontal installation:** Mounting plate slot mechanism must be opposite the dosing head.
- The mounting plate can be used as a drill template, please see fig. 3 for drill hole distances.



Fig. 5 Locate mounting plate



Warning
Make sure that you do not damage any cables and lines during installation!

1. Indicate drill holes.
2. Drill holes.
3. Secure mounting plate using four screws, diameter 5 mm, to the wall, on the bracket or the tank.

4.1.3 Engage pump in mounting plate

1. Attach the pump to the mounting plate support clamps and slide under slight pressure until it engages.



Fig. 6 Engaging the pump

4.1.4 Adjust control cube position

The control cube is fitted to the front of the pump on delivery. It can be turned by 90° so that the user can select to operate the pump from the right or left side.

Caution The enclosure class (IP65 / Nema 4X) and shock protection are only guaranteed if the control cube is installed correctly

Caution Pump must be disconnected from the power supply!

1. Carefully remove both protective caps on the control cube using a thin screwdriver
2. Loosen screws.
3. Carefully lift off control cube only so far from the pump housing that no tensile stress is produced on the flat band cable.
4. Turn control cube by 90° and re-attach.
 - Make sure the O-ring is secure.
5. Tighten screws slightly and attach protective caps.



Fig. 7 Adjusting control cube

4.2 Hydraulic connection



Warning

Risk of chemical burns!

Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!

Caution

**The dosing head may contain water from the factory check!
When dosing media which should not come into contact with water, another medium must be dosed beforehand!**

Caution

Faultless function can only be guaranteed in conjunction with lines supplied by Fink Chem + Tec OHG

Caution

The lines used must comply with the pressure limits as per section 3.1 *Technical data!*

Important information on installation

- Observe suction lift and hose diameter, see section 3.1 *Technical data*.
- Shorten hoses at right angles.
- Ensure that there are no loops or kinks in the hoses.
- Keep suction line as short as possible.
- Route suction line up towards the suction valve.
- Installing a filter in the suction line protects the entire installation against dirt and reduces the risk of leakage.

Hose connection procedure

1. Push union nut and tensioning ring across hose.
2. Push cone part fully into the hose, see fig. 6.
3. Attach cone part with hose to the corresponding pump valve.
4. Tighten union nuts manually
 - do not use tools!
5. Tighten up union nuts after 2-5 operating hours, if using PTFE gaskets!
6. Attach deaeration hose to the corresponding connection (see fig. 3) and run into a container or a collecting tray.

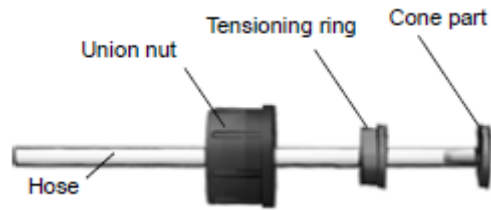


Fig. 8 Hydraulic connection

Note Pressure differential between suction and discharge side must be at least 1 bar/14.5 psi!

Caution Tighten up the dosing head screws once before commissioning and after 2-5 operating hours at 3 Nm.

Installation example

The pump offers various installation options. In the picture below, the pump is installed in conjunction with a suction line, level switch and multifunction valve on a Fink Chem + Tec GmbH & Co. KG tank

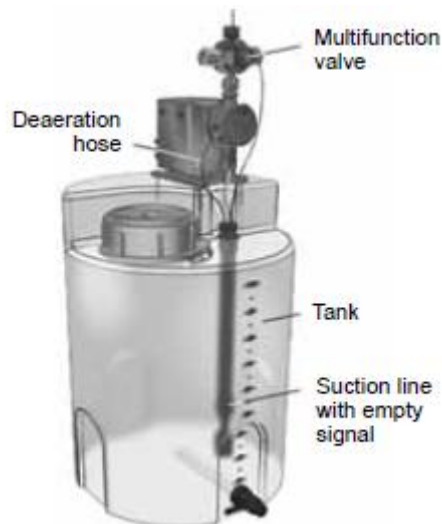


Fig. 9 Installation example

4.3 Electrical connection



Warning
The enclosure class (IP65/Nema 4X) is only guaranteed if lugs or protective caps are correctly installed!



Warning
The pump can start automatically when the mains voltage is switched on!
Do not manipulate mains plug or cable!

The rated voltage of the pump, see section 2.4 *Nameplate*, must conform to local conditions.

Signal connections

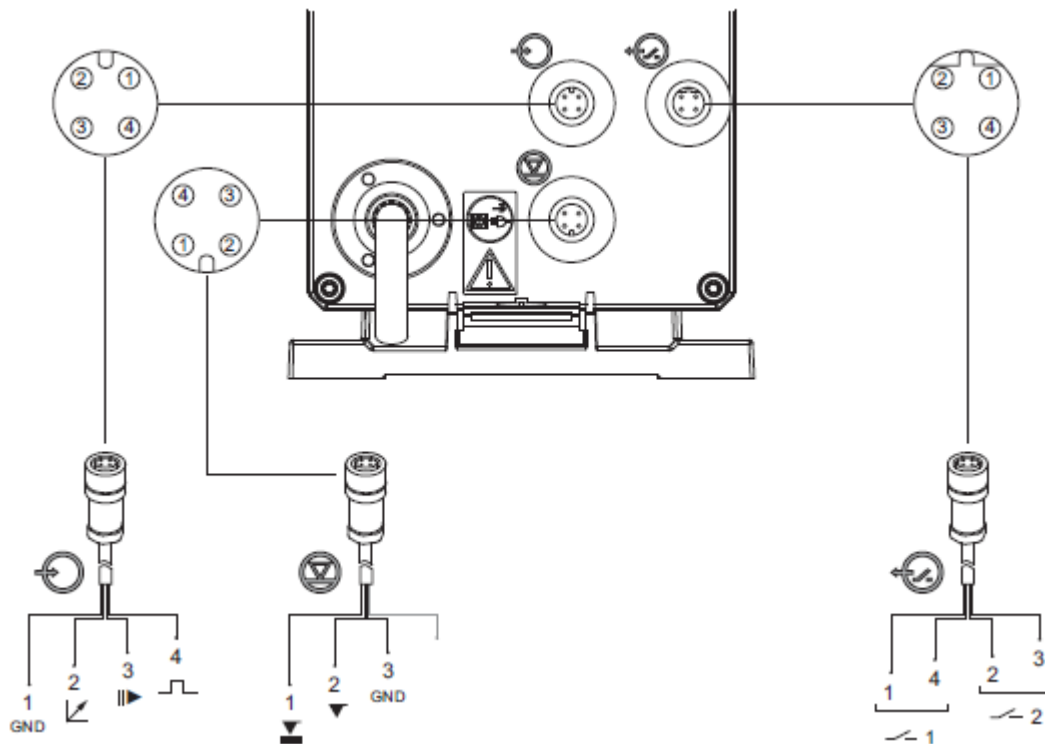


Fig. 10 Wiring diagram of the electrical connections

Analog, external stop and pulse input

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Analog	GND/ (-) mA	(+) mA			mA signal
External stop	GND		X		Pulse
Pulse	GND			X	Pulse

Level signals: empty and low-level signal

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Low-level signal	X		GND		Pulse
Empty signal		X	GND		Pulse

Relay outputs*

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Relay 1	X			X	Pulse
Relay 2		X	X		Pulse


*applies to R032- AR control variant

5. Commissioning


5.1 Setting the menu language

For description of control elements, see section 6.


1. Turn click wheel to highlight the cog symbol.

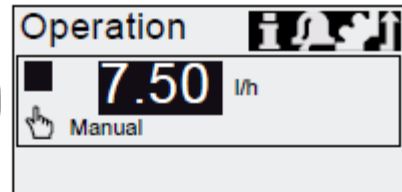


2. Press the click wheel to open the 'Setup' menu

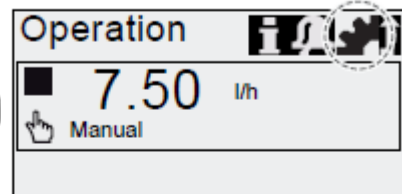

3. Turn the click wheel to highlight the 'Language' menu.

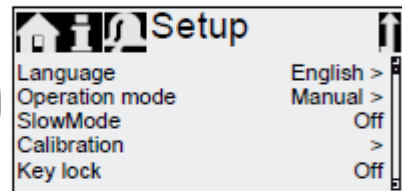


4. Press the click wheel to open the 'Language' menu.

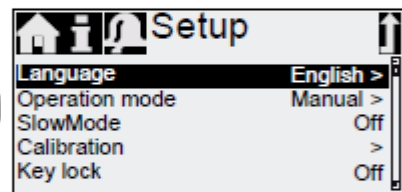

5. Turn the click wheel to highlight the desired language.



6. Press the click wheel to select the highlighted language.

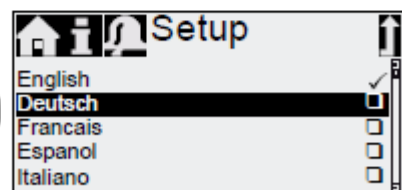

7. Press the click wheel again to confirm the 'Confirm settings' prompt and apply the setting.



Fig. 11 Set menu language

5.2 Deaerating the pump



Warning

The deaeration hose must be connected correctly and inserted into a suitable tank!

1. Open deaeration screw by approximately half turn.
2. Press and hold down the 100% key (deaeration key) until liquid flows continuously without any bubbles from the deaeration hose.
3. Close deaeration screw.

Note

Press the 100% key and simultaneously turn the click wheel clockwise to increase the duration of the process to up to 300 seconds. After setting the seconds, do not press the key any longer.

5.3 Calibrating the pump

The pump is calibrated in the factory for media with a viscosity similar to water rat maximum pump backpressure (see section 3.1 *Technical data*).

If the pump is operated with a backpressure that deviates or if dosing a medium whose viscosity deviates, the pump must be calibrated.

Requirements

- The hydraulics and electrics of the pump are connected (*see section 4. Assembly and installation*).
- The pump is integrated into the dosing process under operating conditions.
- The dosing head and suction hose are filled with dosing medium.
- The pump has been deaerated.

Calibration process – example for R032-6-10

1. Fill a measuring beaker with dosing medium.
Recommended filling volumes:

R032- Typ	6-10	9-7	15-4
Medium V1	0,3 l	0,5 l	1,0 l

2. Read off and note down the fill volume V₁ (e.g. 300 ml).

3. Place the suction hose in the measuring beaker.


4. Start the calibration process in the 'Setup > Calibration' menu.


5. The pump executes 200 dosing strokes and displays the factory calibration value (e.g. 125 ml).


6. Remove the suction hose from the measuring beaker and check the remaining volume V₂ (e.g. 170 ml).


7. From V₁ and V₂, calculate the actual dosed volume V_d=V₁-V₂ (e.g. 300 ml – 170 ml = 130 ml).


8. Set and apply V_d in the calibration menu.
- The pump is calibrated.

V₁ = 300 ml 

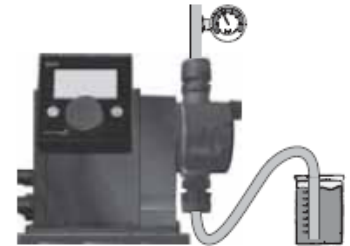

V₂ = 170 ml 

 V_d = V₁ - V₂ = 130 ml

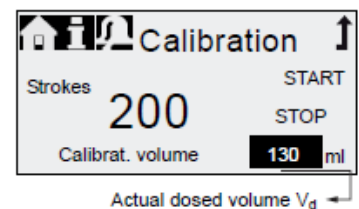

6. Operation

6.1 Operating elements

The pump control panel includes a display and the following control elements.

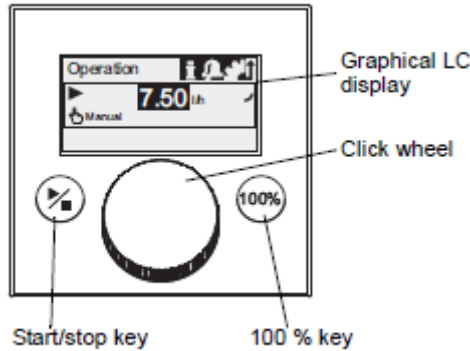


Fig. 12 Control panel

Key	Function
Start/stop key	Starting and stopping the pump.
100% key	The pump doses at maximum flow regardless of the operation mode.

Click wheel

The click wheel is used to navigate through the menus, select settings and confirm them. Turning the click wheel clockwise moves the cursor clockwise in increments in the display. Moving your finger anti-clockwise moves the cursor anti-clockwise.

6.2 Display and symbols

6.2.1 Navigation

In the 'Info', 'Alarm' und 'Setup' main menus, the options and submenus are displayed in the rows below. Use the 'Back' symbol to return to the higher menu level. The scroll bar at the right edge of the display indicates that here are further menu items which are not shown.

The active symbol (current cursor position) flashes. Press the click wheel to confirm your selection and open the next menu level. The active main menu is displayed as text, the other main menus are displayed a symbols. The position of the cursor is highlighted in black in the sub-menus.

When you position the cursor on a value and press the click wheel, a value is selected. Turning the click wheel clockwise increases the value, turning the click wheel anti-clockwise reduces the value. When you now press the click wheel, the cursor will be released again.

6.2.2 Operating states

The operating state of the pump is indicated by a symbol and display colour.

Display	Fault	Operating state		
White	-	Stop	Standby	
Green	-			Running
Yellow	Warning	Stop	Standby	Running
Red	Alarm	Stop	Standby	

6.2.3 Sleep mode (energy-saving mode)

If in the 'Operation' main menu the pump is not operated for 30 seconds, the header disappears. After 2 minutes, the display switches to the 'Operation' main menu and the display brightness is reduced. This state will be cancelled when the pump is operated or a fault occurs.

6.2.4 Overview of display symbols

The following display symbols may appear in the menus.

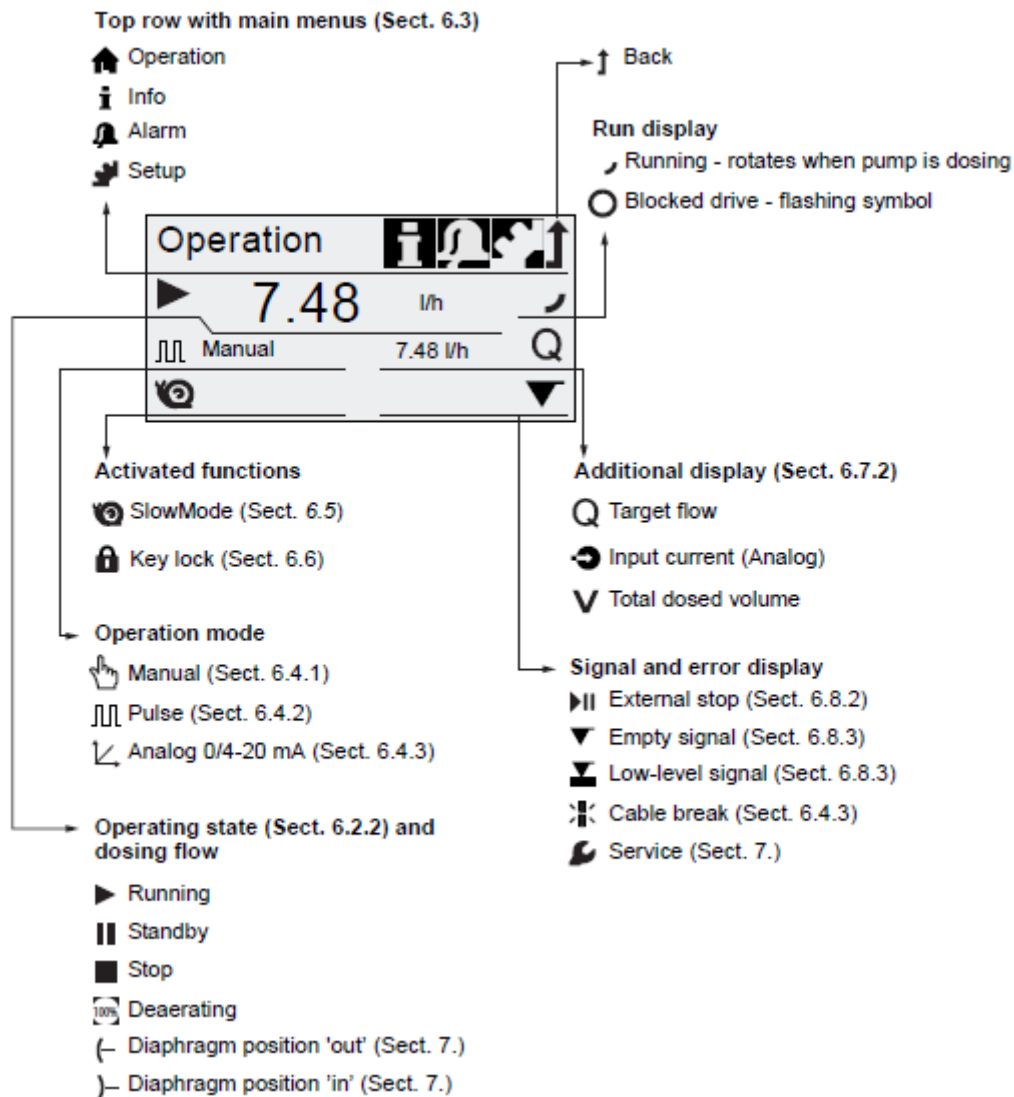



Fig. 13 Overview of display symbols

6.3 Main menus

The main menus are displayed as symbols at the top of the display. The currently active main menu is displayed as text.

6.3.1 Operation


Status information such as the dosing flow, selected operation mode and operating state is displayed in the 'Operation' main menu..

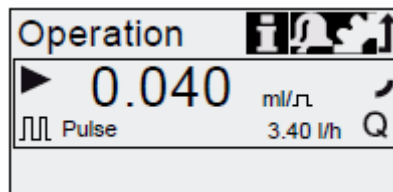

6.3.2 Info

You can find the date, time and information about the active dosing process, various counters, product data and the service system status in the 'Info' main menu. The information can be accessed during operation.

The service system can also be reset form here.

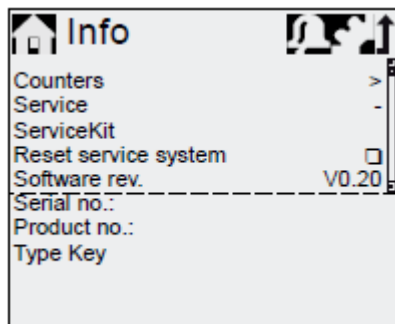


Counters

The 'Info > counters' menu contains the following counters:

Counters	resettable
Volume Total dosed volume [l] or US gallons	Yes
Operating hours Accumulated operating hours (pump switched on) [h]	No
Motor runtime Accumulated motor runtime [h]	No
Strokes Accumulated number of dosing strokes	No
Power on/off Accumulated frequency of switching mains voltage on	No

6.3.3 Alarm

You can view errors in the 'Alarm' main menu.

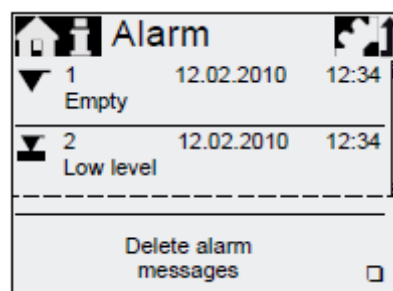

Up to 10 warnings and alarms, together with their date, time and cause, are listed in chronological order. If the list is full, the oldest entry will be overwritten, see Section 8. *Faults*.

6.3.4 Setup

The 'Setup' main menu contains menus for pump configuration. These menus are described in the following sections.

		Section
Language	Deutsch >	5.1
Operation mode	Pulse >	6.4
Pulse memory *	<input type="checkbox"/>	6.4.2
SlowMode	Off >	6.5
Calibration	>	5.3
Key lock	Off >	6.6
Display	>	6.7
Inputs/Outputs	>	6.8
Basic settings	>	6.9

*Menu 'Pulse memory' is only displayed in operation mode 'Pulse'.

6.4 Operation modes

Three different operation modes can be set in the 'Setup > Operation mode' menu.

- **Manual**, see section 6.4.1
- **Pulse***, see section 6.4.2
- **Analog 0-20 mA**, see section 6.4.3
- **Analog 4-20 mA**, see section 6.4.3

6.4.1 Manual

In this operation mode, the pump constantly doses the dosing flow set with the click wheel. The dosing flow is set in l/h or ml/h. The pump automatically switches between the units. Alternatively, the display can be reset to US units (gph).

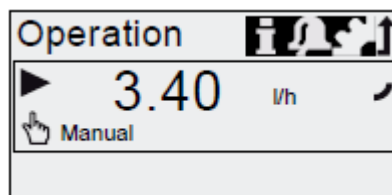


Fig. 14 Manual mode

The setting range depends on the pump type:

Type	Setting range*	
	l/h	gph
R032-6-10	0,0060 – 6,0	0,0015 – 1,5
R032-9-7	0,0090 – 9,0	0,0024 – 2,4
R032-15-4	0,0150 – 15,0	0,0040 – 4,0

*When the SlowMode function is active, the maximum dosing flow is reduced, see section 3.1 *Technical data*.

6.4.2 Pulse

In this operation mode, the pump doses the set dosing volume for each incoming (potential-free) pulse, e.g. from a water meter. There is no direct connection between incoming pulses and dosing strokes. The pump automatically calculates the optimum stroke frequency for dosing the set volume per pulse.

The calculation is based on:

- the frequency of external pulses
- the set dosing volume/pulse.

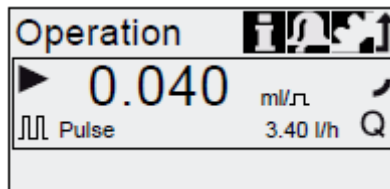


Fig. 15 Pulse operation mode

The dosing volume per pulse is set in ml/pulse using the click wheel. The setting range for the dosing volume depends on the pump type

Type	Setting range/Pulse
R032-6-10	1,6µl - 16,2 ml
R032-9-7	1,7µl - 16,8 ml
R032-15-4	3,2µl - 31,6 ml

The frequency of incoming pulses is multiplied by the set dosing volume. If the pump receives more pulses than it can process at the maximum dosing flow, it runs at the maximum stroke frequency in continuous operation. Excess pulses will be ignored if the memory function is not enabled.

Memory- function

When the 'Setup > Pulse memory' function is enabled, up to 65,000 unprocessed pulses can be saved for subsequent processing.

Note

The contents of the memory will be deleted when:

- switching off the power supply
- switching the operating mode
- the pump is interrupted (e.g. alarm, external stop.)

6.4.3 Analog 0/4 – 20 mA ↙

Applies to R032- AR control variant.

In this operation mode, the pump doses according to the external analog signal. The dosing volume is proportional to the signal input value in mA.

Operation mode	Input value	Dosing flow
4-20 mA	≤ 4.1 mA	0 %
	≥ 19.8 mA	100 %
0-20 mA	≤ 0.1 mA	0 %
	≥ 19.8 mA	100 %

If the input value in operation mode 4-20 mA falls below 2 mA, an alarm is displayed and the pump stops. A cable break or signal transmitter error has occurred. The 'Cable break' symbol is displayed in the 'Signal and error display' area of the display.

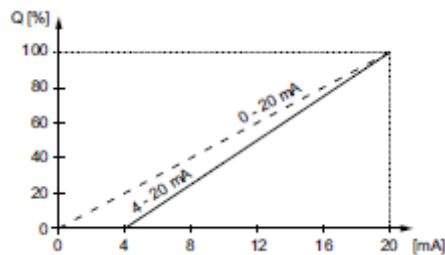


Fig. 16 Analog scaling

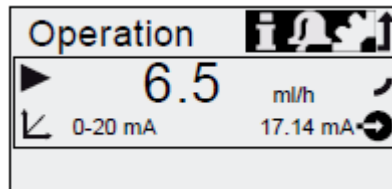


Fig. 17 Analog operation mode

6.5 SlowMode

When the 'SlowMode' function is enabled, the pump slows down the suction stroke. The function is enabled in the 'Setup > SlowMode' menu and is used to prevent cavitation in the following cases:

- for dosing media with a higher viscosity
- for degassing dosing media
- for long suction lines
- for large suction lift

In the 'Setup > SlowMode' menu, the speed of the suction stroke can be reduced to 50% or 25%.

Caution

Enabling the 'SlowMode' function reduces the maximum dosing flow of the pump to the set percentage value!

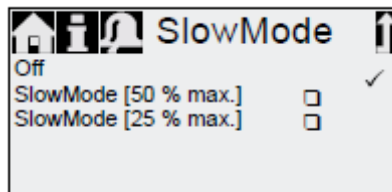


Fig. 18 SlowMode menu

6.6 Key lock

The key lock is set in the 'Setup > Key lock' menu by entering a four-digit code. It protects the pump by preventing changes to settings. Two levels of key lock can be selected:

Level	Description
Settings	All settings can only be changed by entering the lock code. The start/stop key and the 100% key are not locked.
Settings + keys	The start/Stop key and the 100% key and all settings are locked.

It is still possible to navigate in the 'Alarm' and 'Info' main menu and reset alarms.

Temporary deactivation

If the key lock function is activated but settings need to be modified, the keys can be unlocked temporarily by entering the deactivation code. If the code is not entered within 10 seconds, the display automatically switches to the 'Operation' main menu. The key lock remains active.

Deactivation

The key lock can be deactivated in the 'Setup > Key lock' menu via the 'Off' menu point. The key lock is deactivated after the general code '2583' or a predefined custom code has been entered.

6.7 Display Setup

Use the following settings in the 'Setup > Display' menu to adjust the display properties:

- Units (metric/US)
- Display contrast
- Additional display

6.7.1 Units

Metric units (liters/milliliters/bar) or US units (US gallons/PSI) can be selected. According to the operation mode and menu, the following units of measurement are displayed:

Operation mode/ function	Metric units	US units
Manual control	ml/h or l/h	gph
Pulse control	ml/□	ml/□
0/4-20 mA Analogue control	ml/h or l/h	gph
Calibration	ml	ml
Volume counter	l	gal

6.7.2 Additional display

Additional display provides additional information about the current pump status. The value is shown in the display with the corresponding symbol.

In 'Pulse' mode the 'Target flow' information can be displayed with $Q = 1.28$ l/h (see fig. 19).

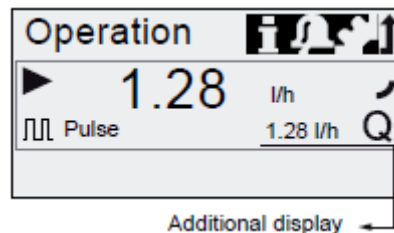





Fig. 19 Display with additional display

The additional display can be set as follows:

Setting	Description
Default display	 Target flow (pulse)  Input current (analog) ¹⁾
Dosed volume	 Dosed vol. since last reset (see <i>Counters</i> on page 20)

1) only R032-AR control variant

6.8 Inputs/outputs

In the 'Setup > Inputs/outputs' menu, you can configure the two outputs 'Relay 1+2' and the signal inputs 'External stop', 'Empty signal' and 'Low level signal':

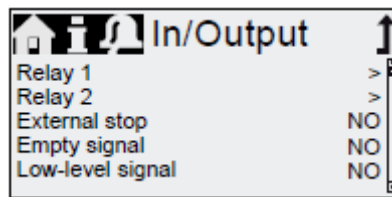


Fig. 20 'Setup > Inputs/outputs' menu

6.8.1 Relay outputs

Applies to R032-AR control variant.

The pump can switch two external signals using installed relays. The relays are switched by potential free pulses. The connection diagram of the relays is shown in section 4.3 *Electrical connection*. Both relays can be allocated with the following signals.

Relay 1 signal	Relay 2 signal	Description
Alarm*	Alarm	Display red, pump stopped (e.g. empty signal, etc.)
Warning*	Warning	Display yellow, pump is running (e.g. low-level signal, etc.)
Stroke signal	Stroke signal*	Each full stroke
Pump dosing	Pump dosing	Pump running and dosing

Contact type		
NO*	NO*	Normally open contact
NC	NC	Normally closed contact

*Factory setting

6.8.2 External stop ▶||

The pump can be stopped via an external pulse, e.g. from a control room. When activating the external stop pulse, the pump switches from the operational state '*Running*' into the operational state '*Standby*'. The corresponding symbol appears in the Signal/error display (see section 6.2.2 Operating states).

Caution Frequent disengagement from the mains voltage, e.g. via a relay, can result in damage to the pump electronics and to the breakdown of the pump. The dosing accuracy is also reduced as a result of internal start procedures.
Do not control the pump via the mains voltage for dosing purposes!
Only use the '*External stop*' function to start and stop the pump!

The contact type is factory-set to closing contact (=>NO). In the '*Setup > Inputs/outputs > External stop*' menu, the setting can be changed to opening contact (=>NC)

6.8.3 Empty and low-level signals ▼ ▽

In order to monitor the fill level in the tank, a dual-level control unit can be connected to the pump.

The pump responds to the signals as follows:

Fill level sensor	Pump status
Low level	<ul style="list-style-type: none"> • Display is yellow • ▼ flashes • Pump continues running
Empty	<ul style="list-style-type: none"> • Display is red • ▼ flashes • Pump stops

Both signal inputs are allocated to the closing contact (=>NO) in the factory. They can be re-allocated in the 'Setup > Inputs/outputs' menu to opening contact (=>NC).

6.9 Basic settings

All settings can be reset to the settings default upon delivery in the 'Setup > Basic settings' menu. Selecting 'Save customer settings' saves the current configuration to the memory. This can then be activated using 'Load customer settings'.

The memory always contains the previously saved configuration. Older memory data is overwritten.

7. Service

In order to ensure a long service life and dosing accuracy, wearing parts such as diaphragms and valves must be regularly checked for signs of wear. Where necessary, replace worn parts with original spare parts made from suitable materials.

Should you have any questions, please contact with us.



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 3).

Take suitable precautions to prevent harm to health and damage to property caused by escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

7.1 Service system

According to the motor runtime service requirements will appear. Service requirements appear regardless of the current operational state of the pump and do not affect the dosing process. If no service requirement has occurred, service has to be performed at least every two years.

Service requirement	Motor runtime (h)*
'Service soon'	7.500
'Service now'	8.000

*Since the last service system reset

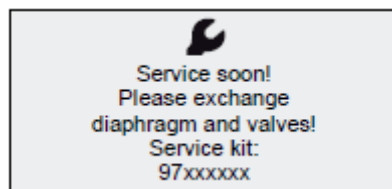


Fig. 21 'Service soon'

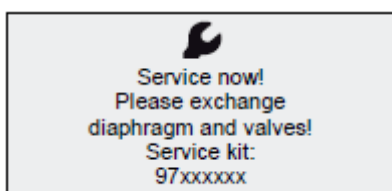



Fig. 22 'Service now'

The service requirement signals when the replacement of wearing parts is due and displays the number of the service kit. Press the click wheel to temporarily hide the service prompt. When the "Service now" message appears (displayed daily), the pump must be serviced immediately.

To signalise in the 'Operation' menu, the Symbol  appears in the 'Signal/error display' area of the display. The number of the service kit required is also displayed in the 'Info' menu. For media which result in increased wear, the service interval must be shortened.

7.2 Perform service

Only spare parts and accessories from Fink Chem + Tec OHG should be used for maintenance. The usage of non-original spare parts and accessories renders any liability for resulting damages null and void.



Warning

When dosing dangerous media, observe corresponding precautions in the safety data sheets!

Risk of chemical burns!


Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!

Do not allow any chemicals to leak from the pump. Collect and dispose of all chemicals correctly!

Caution

Before any work to the pump, the pump must be disconnected from the mains. The system must be pressureless!



7.2.1 Dosing head overview

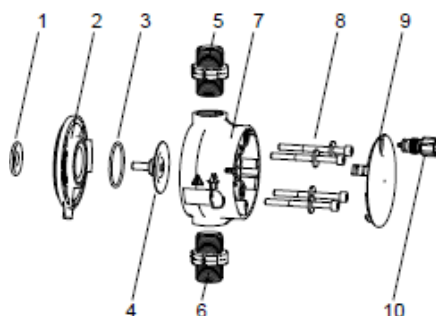

1	Safety diaphragm
2	Flange
3	O-ring
4	Diaphragm
5	Valve on discharge side
6	Valve on suction side
7	Dosing head
8	Screws with discs
9	Cover
10	Deaeration valve


Fig. 23 Dosing head, exploded view

7.2.2 Dismantling the diaphragm and valves

1. Make system pressureless.
2. Empty dosing head before maintenance and flush it if necessary.
3. Set pump to 'Stop'  operational state using the 'Start/stop key'
4. Press the 'Start/stop' and '100%' keys at the same time to put the diaphragm into 'out' position.
 - Symbol  must be displayed as the operational state (see fig. 13).
5. Take suitable steps to ensure that the returning liquid is safely collected.
6. Dismantle suction, pressure and deaeration hoses.

7. Dismantle valves on suction and discharge side (5, 6).
8. Remove the cover (9).
9. Loosen screws (8) on the dosing head (7) and remove the screws and discs.
10. Remove the dosing head (7).
11. Unscrew diaphragm (4) counter-clockwise and remove with flange (2)

7.2.3 Reassembling the diaphragm and valves

1. Attach flange (2) correctly and screw on new diaphragm (4) clockwise.
 - Make sure that the O-ring (3) is seated correctly!
2. Press the 'Start/stop' and '100%' keys at the same time to put the diaphragm into 'in' position.
 - Symbol  must be displayed as the operational state (see fig. 13).
3. Attach the dosing head (7).
4. Install screws with discs (8) and cross-tighten.
 - Torque: 3 Nm.
5. Attach the cover (9).
6. Install new valves (5, 6).
 - Do not interchange valves and pay attention to direction of arrow.
7. Connect suction, pressure and deaeration hose (see section 4.2 *Hydraulic connection*)
8. Press the 'Start/Stop' key to leave the service mode.
9. Deaerate dosing pump (see section 5.2 *Deaerating the pump*).
10. Please observe the notes on commissioning in section 5. *Commissioning*!

7.3 Resetting the service system

After performing the service, the service system must be reset using the 'Info > Reset service system' function.

7.4 Repairs



Warning

The pump housing must only be opened by personnel authorised by Fink Chem + Tec OHG!

Repairs must only be carried out by authorised and qualified personnel!

Switch off the pump and disconnect it from the voltage supply before carrying out maintenance work and repairs!

After consulting Fink Chem + Tec OHG, please send the pump, together with the safety declaration completed by a specialist, to Fink Chem + Tec OHG. The safety declaration can be found at the end of these instructions. It must be copied, completed and attached to the pump.

Caution

If the pump has been used to dose toxic liquids or liquids hazardous to health, the pump must be cleaned prior to dispatch!

If the above requirements are not met, the Fink Chem + Tec OHG may refuse to accept delivery of the pump. The shipping costs will be charged to the sender.

8. Faults

In the event of faults in the dosing pump, a warning or an alarm is triggered. The corresponding fault symbol flashes in the 'Operation' menu, see section 8.1 *List of faults*. The cursor jumps to the 'Alarm' main menu symbol. Press the click wheel to open the 'Alarm' menu and, where necessary, faults to be acknowledged will be acknowledged.


A yellow display indicates a warning and the pump continues running.

A red display indicates an alarm and the pump is stopped.

The last 10 faults are stored in the 'Alarm' main menu. When a new fault occurs, the oldest fault is deleted.

The two most recent faults are shown in the display, you can scroll through all the other faults.

The time and cause of the fault are displayed.

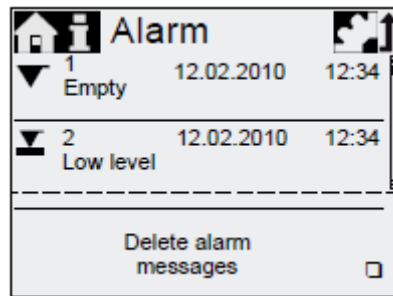

The list of faults can be deleted at the end of the list.

If there is a service requirement, this appears when the 'Alarm' menu is opened. Press the click wheel to temporarily close the service prompt (see section 7.1 Service system).

8.1 List of faults

8.1.1 Faults with error message

Display in the 'Alarm' menu	Possible cause	Possible remedy
▼ Empty (Alarm)	<ul style="list-style-type: none"> Dosing medium tank empty 	<ul style="list-style-type: none"> Fill tank Check contact setting (NO/NC)
⚠ Low level (Warning)	<ul style="list-style-type: none"> Dosing medium tank almost empty 	
○ Motor blocked (Alarm)	<ul style="list-style-type: none"> Backpressure greater than nominal pressure Damage to gears 	<ul style="list-style-type: none"> Reduce backpressure Arrange for repair to drive if necessary.
⚡ Cable break (Alarm)	<ul style="list-style-type: none"> Defect in analog line 4-20 mA (input current < 2 mA) 	<ul style="list-style-type: none"> Check line/plug connections and replace, if necessary. Check signal transmitter.
🔄 Service soon/now (Warning)	<ul style="list-style-type: none"> Time interval for service expired 	<ul style="list-style-type: none"> Perform service (see section 7.2 Perform service).

8.1.2 General faults

Fault	Possible cause	Possible remedy
Dosing flow too high	Inlet pressure greater than backpressure	<ul style="list-style-type: none"> • Install additional spring-loaded valve (approx. 3 bar) on the discharge side. • Increase pressure differential.
	Incorrect calibration	Calibrate the pump (see section 5.3 <i>Calibrating the pump</i>).
No dosing flow or dosing flow too low	Air in dosing head	Deaerate the pump
	Faulty diaphragm	Change the diaphragm (see section 7.2 <i>Perform service</i>).
	Leakage/fracture in lines	Check and repair lines.
	Valves leaking or blocked	Check and clean valves.
	Valves installed incorrectly	<ul style="list-style-type: none"> • Check that the arrow on the valve housing is pointing in the direction of flow. Check whether all O-rings are installed correctly.
	Blocked suction line	<ul style="list-style-type: none"> • Clean suction line/install filter.
	Suction lift too high	<ul style="list-style-type: none"> • Reduce suction lift. • Install priming aid. • Enable 'Slow Mode' (see section 6.5 <i>SlowMode</i>).
	Viscosity too high	<ul style="list-style-type: none"> • Enable 'Slow Mode' (see section 6.5 <i>SlowMode</i>). • Use hose with larger diameter. • Install spring-loaded valve on

		the discharge side.
	Pump outside the calibration	<ul style="list-style-type: none"> Calibrate the pump (see section 5.3 <i>Calibrating the pump</i>).
	Deaeration valve open	<ul style="list-style-type: none"> Close the deaeration valve.
Irregular dosing	Valves leaking or blocked	Tighten up valves, replace valves if necessary (see section 7.2 <i>Perform service</i>).
	Backpressure fluctuations	Keep backpressure constant.
Liquid escaping from the discharge opening on the flange	Faulty diaphragm	Change the diaphragm (see section 7.2 <i>Perform service</i>).
Liquid escaping	Dosing head screws not screwed in as far as they will go	Tighten up screws (see section 4.2 <i>Hydraulic connection</i>).
	Valves not screwed in as far as they will go	Tighten up valves/union nuts (see section 4.2 <i>Hydraulic connection</i>).
Pump not sucking in	Suction lift too high	Reduce suction lift, if necessary provide positive inlet pressure.
	Backpressure too high	Open the deaeration valve.
	Soiled valves	Flush system, replace valves if necessary (see section 7.2 <i>Perform service</i>).

9. Disposal

This product and all its associated parts must be disposed of in an environmentally friendly manner. Use appropriate waste collection services. If there is no such facility or the facility refuses to accept these materials used in the product, the product can be sent to the Fink Chem + Tec OHG.

Appendix


Safety declaration

Please copy, fill in and sign this sheet and attach it to the pump returned for service.

Product type (nameplate) _____
 Model- number (nameplate) _____
 Dosing medium _____

Fault description

Please make a circle around the damaged parts.
 In the case of an electrical or functional fault, please mark the cabinet.

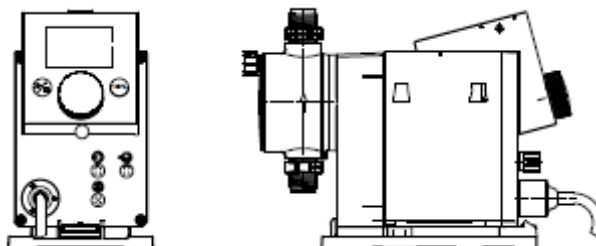

Please describe the error / cause of the error in brief.

We hereby declare that the pump has been cleaned and is completely free from chemical, biological and radioactive substances.

Date, signature and Company stamp

© 2014 Fink Chem + Tec OHG

The texts, images and examples in this manual are carefully compiled. Fink Chem + Tec OHG is not liable for possible remaining incorrect details and following consequences or breach of other third party rights neither legal responsibility nor other liability. We are thankful for any notifications or improvement suggestions.

The material, Soft and Hardware terms and names mentioned in this manual are usually registered trademarks and underlie the legal regulations.

The manual protected by copyright. All rights reserved. No part of this manual may be reproduced by photo copy, microfilm or other means or transferred to machines, especially data processing equipment, in the appropriate language. Presentation by submission in lectures, radio and television is allowed only with our written consent.



EG - Declaration of Conformity

Machinery Directive 2006/42/EG, II 1, A

Membrane Metering Pumps

R 032-6-10 PTFE

Manufacturer Fink Chem+Tec GmbH & Co. KG
Maybachstraße 11
D-70771 Leinfelden-Echterdingen

We declare that this delivered R 032/DDC Metering Pump and in all versions are in conformity with the following standards or standardized documents according to the provisions of the directives of the EC state members.

- Machinery Directive (2006/42/EG).
Standards used:
EN 809: 1998
EN ISO 12100-1+A1: 2009
EN ISO 12100-2+A1: 2009
- EMC Directive (2004/108/EG).
Standards used:
EN 61000-6-2: 2005,
EN 61000-6-4: 2007
- Low Voltage Directive (2006/95/EG).
Standard used: EN 60204-1+A1: 2009
- Electrical equipment applicated within specified voltage ranges
Norm EN 61 010 -1 und EN 61 010-2-010/A1

Person authorised to compile technical file and empowered to sign the EC declaration of conformity.

Manufacturer/Supplier
Grundfos/Fink Chem+Tec GmbH & Co. KG

A. Fink

Date
29.07.2014

Operating Instruction

Membrane Metering Pump

Ritmo 033-xx

FINK Chem + Tec GmbH & Co. KG

Maybachstraße 11

70771 Leinfelden-Echterdingen

Tel. 0711/99755427

Fax 0711/99755428

info@finkct.de

www.finkct.de

Contents

Index of contents

1.	Safety instructions	4
1.1	Identification of safety instructions in these instructions	4
1.2	Qualification and training of personnel	4
1.3	Safety instructions for the operator/ user	4
1.4	Safety of the system in the event of a failure in the dosing pump	5
1.5	Dosing chemicals	5
1.6	Safety instructions for service, inspection and mounting	5
2.	General	6
2.1	Applications	6
2.2	Improper operating methods	6
2.3	Warranty	6
2.4	Nameplate	7
2.5	Type key	8
2.6	Device overview	9
3.	Technical data / dimensions	10
3.1	Technical data	10, 11
3.2	Dimensions	12
4.	Assembly and installation	13
4.1	Pump assembly	13
4.1.1	Requirements	13
4.1.2	Align and install mounting plate	13
4.1.3	Engage pump in mounting plate	13
4.1.4	Adjust control cube position	14
4.2	Hydraulic connection	14, 15
4.3	Electrical connection	16
5.	Commissioning	18
5.1	Setting the menu language	18
5.2	Deaerating the pump	19
5.3	Calibrating the pump	19, 20
6.	Operation	21
6.1	Operating elements	21
6.2	Display and symbols	21
6.2.1	Navigation	21
6.2.2	Operating states	21
6.2.3	Sleep mode (energy-saving mode)	22
6.2.4	Overview of display symbols	22
6.3	Main menus	23
6.3.1	Operation	23
6.3.2	Info	23
6.3.3	Alarm	23
6.3.4	Setup	24
6.4	Operation modes	24
6.4.1	Manual	24
6.4.2	Pulse	24
6.4.3	Analog 0/4 – 20mA	25, 26
6.4.4	Batch (pulse-based)	27
6.4.5	Dosing timer, cycle	28
6.4.6	Dosing timer, week	29
6.5	Analog output	30
6.6	SlowMode	30
6.7	Flow Control	31
6.8	Pressure monitoring	32

6.8.1	Pressure setting ranges	32
6.8.2	Calibration of pressure sensor	32, 33
6.9	Flow measurement	33
6.10	AutoFlowAdapt	33, 34
6.11	Auto deaeration	34
6.12	Key lock	34
6.13	Display Setup	35
6.13.1	Units	35
6.13.2	Additional display	35
6.14	Time/ Date	36
6.15	Bus communication	36
6.16	Inputs/ outputs	36
6.16.1	Relay outputs	36, 37
6.16.2	External stop	37
6.16.3	Empty and low-level signals	37
6.17	Basic settings	37
7.	Service	38
7.1	Service system	38
7.2	Perform service	39
7.2.1	Dosing head overview	39
7.2.2	Dismantling the diaphragm and valves	39
7.2.3	Reassembling the diaphragm and valves	39
7.3	Resetting the service system	40
7.4	Repairs	40
8.	Faults	40
8.1	List of faults	41
8.1.1	Faults with error message	41, 42
8.1.2	General faults	43
9.	Disposal	43
10.	Safety declaration	44
11.	EG- Declaration of Conformity	45

1. Safety instructions

These installation and operating instructions contain general instructions that must be observed during installation, operation and maintenance of the pump.

It must therefore be read by the installation engineer and the relevant qualified operator prior to installation and start-up, and must be available at the installation location at all times.

Apart from these general safety instructions there are further special instructions in other sections to which attention must be given.

The instructions mounted directly on the metering pump must be heeded and always kept in a visible condition.

Besides the general safety instructions the operator must consider the existing national regulations for accident prevention as well as the internal working, company, and safety regulations.

1.1 Identification of safety instructions in these instructions

The safety instructions are identified by the following symbols:



Warning

If these safety instructions are not observed, it may result in personal injury!

Caution

If these safety instructions are not observed, it may result in malfunction or damage to the equipment!

Note

Notes or instructions that make the job easier and ensure safe operation.

1.2 Qualification and training of personnel

The personnel responsible for the installation, operation and service must be appropriately qualified for these tasks. Areas of responsibility, levels of authority and the supervision of the personnel must be precisely defined by the operator. If necessary, the personnel must be trained appropriately.

Risks of not observing the safety instructions

Non-observance of the safety instructions may have dangerous consequences for the personnel, the environment and the pump and may result in the loss of any claims for damages.

It may lead to the following hazards:

- Personal injury from exposure to electrical, mechanical and chemical influences.
- Damage to the environment and personal injury from leakage of harmful substances.

1.3 Safety instructions for the operator/ user

The safety instructions described in these instructions, existing national regulations on health protection, environmental protection and for accident prevention and any internal working, operating and safety regulations of the operator must be observed.

Information attached to the pump must be observed.

Leakages of dangerous substances must be disposed of in a way that is not harmful to the personnel or the environment.

Damage caused by electrical energy must be prevented, see the regulations of the local electricity supply company and the regulations VDE.

Caution

Before starting work on the pump, the pump must be disconnected from the mains. The system must be pressureless!

Only original accessories and original spare parts should be used. Using other parts can result in exemption from liability for any resulting consequences.

An existing guards for moving parts must not be removed while the system is in operation.

1.4 Safety of the system in the event of a failure in the dosing pump

The dosing pump was designed according to the latest technologies and is carefully manufactured and tested.

If it fails regardless of this, the safety of the overall system must be ensured. Use the relevant monitoring and control functions for this.

Caution

Make sure that any chemicals that are released from the pump or any damaged lines do not cause damage to system parts and buildings. The installation of leak monitoring solutions and drip trays is recommended.

1.5 Dosing chemicals



Warning

Before switching the supply voltage back on, the dosing lines must be connected in such a way that any chemicals in the dosing head cannot spray about and put people at risk.

The dosing medium is pressurized and can be harmful to health and the environment.



Warning

When working with chemicals, the accident prevention regulations applicable at the installation site should be applied (e.g. wearing protective clothing).

Observe the chemical manufacturer's safety data sheets and safety instructions when handling chemicals!



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 3).

Take suitable precautions to prevent harm to health and damage to property from escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

Changing the diaphragm, see section 7. Service.

Caution

A deaeration hose, which is routed into a container, e.g. a drip tray, must be connected to the deaeration valve.

Caution

The dosing medium must be in liquid aggregate state!

Observe the freezing and boiling points of the dosing medium!

Caution

The resistance of the parts that come into contact with the dosing medium, such as the dosing head, valve ball, gaskets and lines, depends on the medium, media temperature and operating pressure.

Ensure that parts in contact with the dosing medium are resistant to the dosing medium under operation conditions.

Should you have any questions regarding the material resistance and suitability of the pump for specific dosing media, please contact with Fink Chem + Tec OHG

1.6 Safety instructions for service, inspection and mounting

The organization is responsible for execution of all service, inspection and mounting work is only done through authorized qualified persons who are instructed with an adequate study of the mounting and operating instructions.

Fundamentally, all work on the metering pump is executed only when the pump is not running. The stopping procedure of the pump must be executed as described in the operating instructions.

Directly after termination of a process all safety and protection fittings must be placed back into place i.e. set in to function.

Before renewed operation all instructions in the section 'Putting into operation' must be executed.

2. General

The dosing pump R033 is a self-priming diaphragm pump. It consists of a housing with stepper motor and electronics, a dosing head with diaphragm and valves and the control cube.

Excellent dosing features of the pump:

- Optimal intake even with degassing media, as the pump always works at full suction stroke volume.
- Continuous dosing, as the medium is sucked up with a short suction stroke, regardless of the current dosing flow, and dosed with the longest possible dosing stroke.

2.1 Applications

The pump is suitable for liquid, non-abrasive, non-flammable and non-combustible media strictly in accordance with the instructions in these installation and operating instructions. The stated limiting values as shown in the technical data must not be exceeded in any case.

Areas of Applikation

- Drinking water treatment
- Wastewater treatment
- Swimming pool water treatment
- Boiler water treatment
- CIP (Clean-In-Place)
- Cooling water treatment
- Process water treatment
- Wash plants
- Chemical industry
- Ultrafiltration processes and reverse osmosis
- Irrigation
- Paper and pulp industry
- Food and beverage industries

2.2 Improper operating methods

The operational safety of the pump is only guaranteed if it is used in accordance with section 2.1 Applications.



Warning

Other applications or the operation of pumps in ambient and operation conditions, which are not approved, are considered improper and are not permitted. The Fink Chem + Tec OHG cannot be held liable for any damage resulting from incorrect use.



Warning

The pump is NOT approved for operation in potentially explosive areas!



Warning

A sunscreen is required for outdoor installation!

2.3 Warranty

A guarantee claim in accordance with our general terms of sale and delivery is only valid if the following requirements are fulfilled:

- The pump is used in accordance with the information within this manual.
- The pump is not dismantled or incorrectly handled.
- The maintenance is carried out by authorised and qualified personnel.
- Original spare parts are used for repairs during maintenance.

2.4 Nameplate

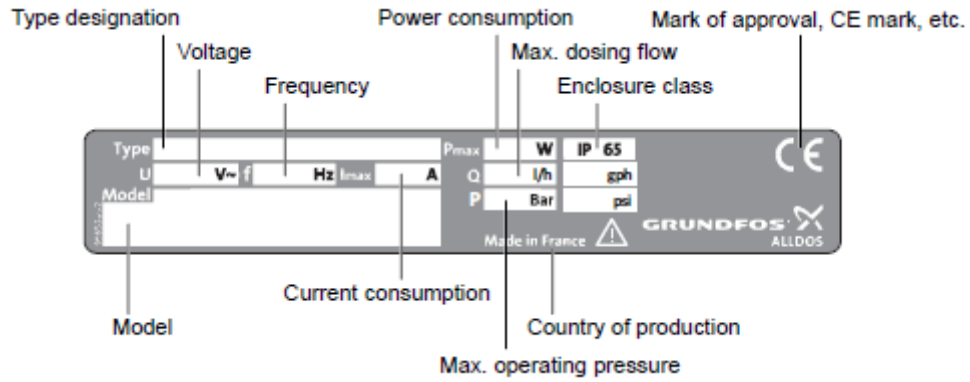


Fig. 1 Nameplate

2.5 Type key

The type key is used to identify the precise pump and is not used for configuration purposes.

Code	Example	R033	7.5--16	AR-	PP/	V/	C-	F-	3	1	U2U2	F	G
	Pump type												
	Max. flow [l/h]												
	Max. pressure [bar]												
	Control variant												
AR	Standard												
FC	AR with FlowControl												
FCM	FC with integrated flow measurement												
	Dosing head material												
PP	Polypropylene												
PVC	PVC (polyvinyl chloride) (PVC dosing heads only up to 10 bar)												
PV	PVDF (polyvinylidene fluoride)												
SS	Stainless steel DIN 1.4401												
PVC-P3	PVC with Plus ³												
	Gasket material												
E	EPDM												
V	FKM												
T	PTFE												
	Valve ball material												
C	Ceramic												
SS	Stainless steel DIN 1.4401												
	Control cube position												
F	Front-mounted (can be changed to the right or left)												
	Voltage												
3	1 x 100-240 V, 50/60 Hz												
	Valve type												
1	Standard												
2	Spring-loaded (HV version)												
	Suction/discharge side connection												
U2U2	Hose, 4/6 mm, 6/9 mm, 6/12 mm, 9/12 mm												
U7U7	Hose 1/8" x 1/4"; 0.17" x 1/4"; 1/4" x 3/8"; 3/8" x 1/2"												
AA	Threaded Rp 1/4", female (stainless steel)												
VV	Threaded 1/4" NPT, female (stainless steel)												
XX	No connection												
	Installation set*												
I001	Hose, 4/6 mm (up to 7.5 l/h, 16 bar)												
I002	Hose, 9/12 mm (up to 60 l/h, 13 bar)												
I003	Hose 0.17" x 1/4" (up to 7.5 l/h, 16 bar)												
I004	Hose, 3/8" x 1/2" (up to 60 l/h, 10 bar)												
	Power plug												
F	EU (Schuko)												
B	USA, Canada												
G	UK												
I	Australia, New Zealand, Taiwan												
E	Switzerland												
J	Japan												
L	Argentina												
	Design												
G	Grundfos Alldos												

* including: 2 pump connections, foot valve, injection unit, 6 m PE discharge hose, 2 m PVC suction hose, 2 m PVC deaeration hose (4/6 mm)

2.6 Device overview

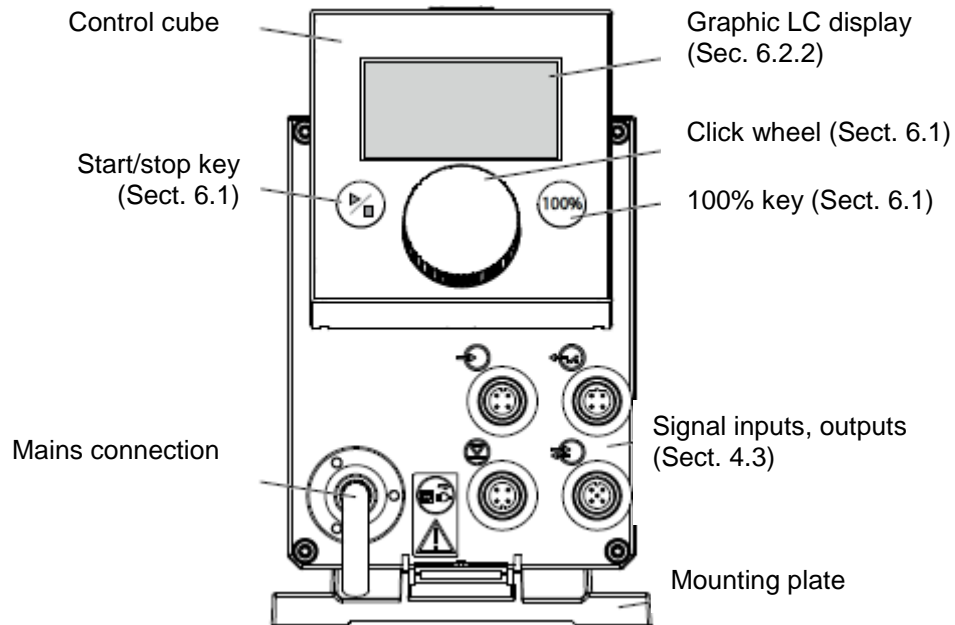


Fig. 2 Front view of the pump

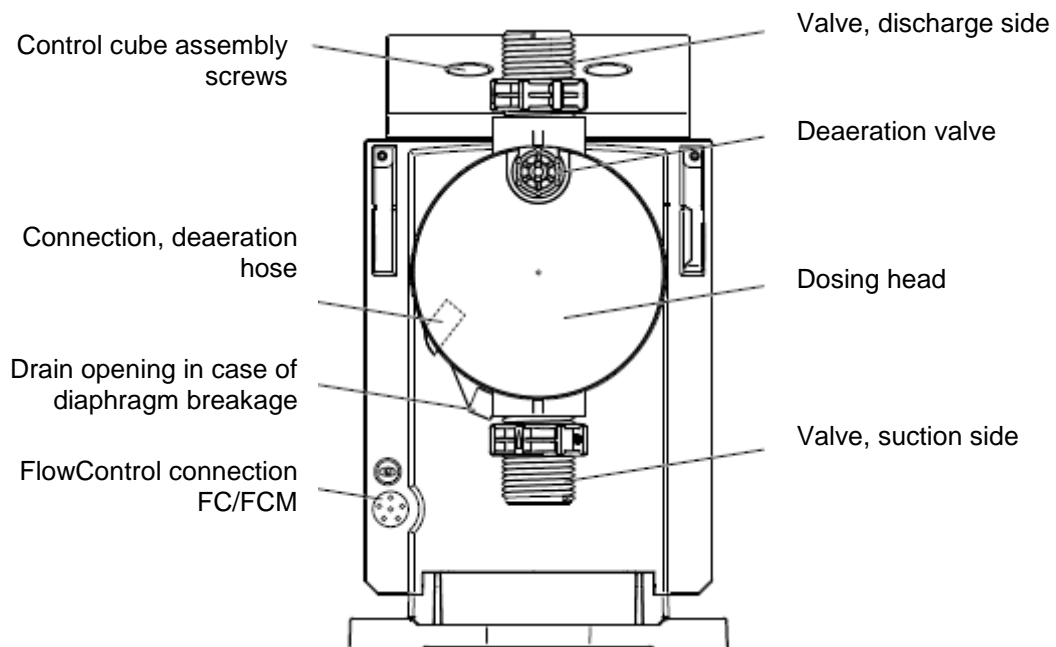


Fig. 3 Rear view of the pump

3. Technical data / dimensions

3.1 Technical data

Data			Pump type R033-			
			7-16	12-10	17-7	30-4
Mechanical data	Turndown ration (setting range)	[1:X]	3000	1000	1000	1000
	Max. dosing flow	[l/h]	7,5	12,0	17,0	30,0
		[gph]	2,0	3,1	4,5	8,0
	Max. dosing flow with SlowMode 50 %	[l/h]	3,75	6,00	8,50	15,00
		[gph]	1,00	1,55	2,25	4,00
	Max. dosing flow with SlowMode 25%	[l/h]	1,88	3,00	4,25	7,50
		[gph]	0,50	0,78	1,13	2,00
	Min. dosing flow	[l/h]	0,0025	0,0120	0,0170	0,0300
		[gph]	0,0007	0,0031	0,0045	0,0080
	Max. operating pressure	[bar]	16	10	7	4
		[psi]	230	150	100	60
	Max. stroke frequency ¹⁾	[Hübe/min]	190	155	205	180
	Stroke volume	[ml]	0,74	1,45	1,55	3,10
	Accuracy of repeatability	[%]	+/-1			
	Max. suction lift during operation ²⁾	[ml]	6			
	Max. suction lift when priming with wet valves ²⁾	[m]	2	3	3	2
	Min. pressure difference between suction and discharge side	[bar]	1 (FC und FCM: 2)			
	Max. pressure, suction side	[bar]	2			
	Max. viscosity in SlowMode 25% with spring-loaded valves ³⁾	[mPas] (=cP)	2500	2500	2000	1500
	Max. viscosity in SlowMode 50% with spring-loaded valves ³⁾	[mPas] (=cP)	1800	1300	1300	600
	Max. viscosity without SlowMode with spring-loaded valves ³⁾	[mPas] (=cP)	600	500	500	200
	Max. viscosity without spring-loaded valves ³⁾	[mPas] (=cP)	50	300	300	150
	Min. diameter of hose/pipe on suction/discharge side ²⁾⁴⁾	[mm]	4	6	6	9
	Min. diameter of hose/pipe on suction side for highly viscous media (HV) ⁴⁾	[mm]	9			
	Min. diameter of hose/pipe on discharge side for highly viscous media (HV) ⁴⁾	[mm]	9			
	Max. media temperature	[°C]	45			
	Min. media temperature	[°C]	-10			
	Max. ambient temperature	[°C]	45			
	Min. ambient temperature	[°C]	0			
	Max. storage temperature	[°C]	70			
Min. storage temperature	[°C]	-20				
Electrical data	Voltage	[V]	100-240 V, 50-60 Hz			
	Length of mains cable	[m]	1,5			
	Max. current consumption (100 V)	[A]	0,18			
	Max. current consumption (230 V)	[A]	0,08			
	Max. power consumption P ₁	[W]	18 / 24 ⁵⁾			
	Enclosure class		IP 65, Nema 4X			
	Electrical safety class		II			

Signal input	Max. load for level input		12 V, 5 mA		
	Max. load for pulse input		12 V, 5 mA		
	Max. load for external stop		12 V, 5 mA		
	Min. pulse length	[ms]	5		
	Max. pulse frequency	[Hz]	100		
	Impedance at 0/4-20 mA analog input	[Ω]	15		
Signal input	Max. resistance in level circuit	[Ω]	1000		
	Max. resistance in pulse circuit	[Ω]	1000		
Signal output	Max. ohmic load on relay output	[A]	0,5		
	Max. voltage on relay output	[V]	30 VDC/ 30 VAC		
	Impedance at 0/4-20 mA analog output	[Ω]	500		
Weight/ size	Weight (PVC, PP, PVDF)	[kg]	2,4	2,4	2,6
	Weight (stainless steel)	[kg]	3,2	3,2	4,0
	Diaphragm diameter	[mm]	44	50	7,4
Sound pressure level	Max. sound pressure level	[dB(A)]	60		
Approvals		CE, CSA-US, NSF61, GHOST, C-Tick			

- 1) The maximum stroke frequency varies depending on calibration
- 2) Data is based on measurements with water
- 3) Maximum suction lift: 1 m, dosing flow reduced (approx. 30%)
- 4) Length of suction line: 1.5 m / length of discharge line: 10 m (at max. viscosity)
- 5) With E- Box

3.2 Dimensions

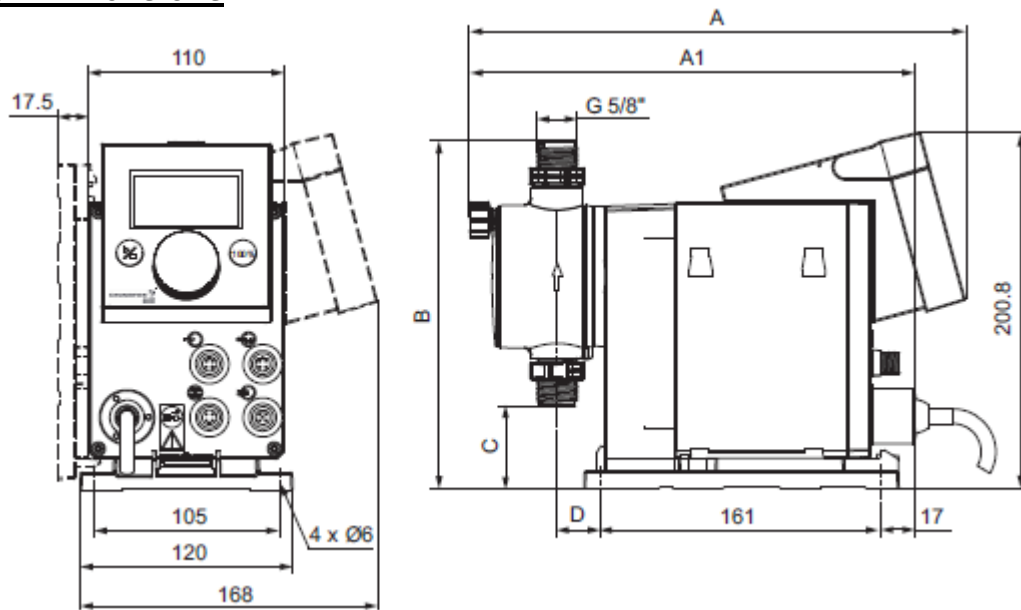


Fig.4 Dimensional drawing

Pump type	A (mm)	A1 (mm)	B (mm)	C (mm)	D (mm)
R033-7-16	280	251	196	46,5	24
R033-12-10/17-7	280	251	200,5	39,5	24
R033-30-4	295	267	204,5	35,5	38,5

4. Assembly and installation

4.1 Pump assembly

The pump is delivered with a mounting plate. The mounting plate can be mounted vertically, e.g. on a wall, or horizontally, e.g. on a tank. It takes just a few quick steps to firmly secure the pump to the mounting plate by means of a slot mechanism.

The pump can easily be released from the mounting plate for maintenance.

4.1.1 Requirements

- The mounting surface must be stable and must not vibrate.
- Dosing must flow upwards vertically.

4.1.2 Align and install mounting plate

- **Vertical installation:** Mounting plate slot mechanism must be above.
- **Horizontal installation:** Mounting plate slot mechanism must be opposite the dosing head.
- The mounting plate can be used as a drill template, please see fig. 4 for drill hole distances.



Fig. 5 Locate mounting plate



Warning
Make sure that you do not damage any cables and lines during installation!

1. Indicate drill holes.
2. Drill holes.
3. Secure mounting plate using four screws, diameter 5 mm, to the wall, on the bracket or the tank.

4.1.3 Engage pump in mounting plate

1. Attach the pump to the mounting plate support clamps and slide under slight pressure until it engages.



Fig. 6 Engaging the pump

4.1.4 Adjust control cube position

The control cube is fitted to the front of the pump on delivery. It can be turned by 90° so that the user can select to operate the pump from the right or left side.

Caution The enclosure class (IP65 / Nema 4X) and shock protection are only guaranteed if the control cube is installed correctly

Caution Pump must be disconnected from the power supply!

1. Carefully remove both protective caps on the control cube using a thin screwdriver
2. Loosen screws.
3. Carefully lift off control cube only so far from the pump housing that no tensile stress is produced on the flat band cable.
4. Turn control cube by 90° and re-attach.
- Make sure the O-ring is secure.
5. Tighten screws slightly and attach protective caps.



Fig. 7 Adjusting control cube

4.2 Hydraulic connection



Warning

Risk of chemical burns!

Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!

Caution

**The dosing head may contain water from the factory check!
When dosing media which should not come into contact with water, another medium must be dosed beforehand!**

Caution

Faultless function can only be guaranteed in conjunction with lines supplied by Fink Chem + Tec OHG

Caution

The lines used must comply with the pressure limits as per section 3.1 *Technical data!*

Important information on installation

- Observe suction lift and hose diameter, see section 3.1 *Technical data*.
- Shorten hoses at right angles.
- Ensure that there are no loops or kinks in the hoses.
- Keep suction line as short as possible.
- Route suction line up towards the suction valve.
- Installing a filter in the suction line protects the entire installation against dirt and reduces the risk of leakage.

- *Only control variant FC/FCM:* For discharge quantities < 1 l/h we recommend the use of an additional spring-loaded valve (approx 3 bar) on the discharge side for the safe generation of the necessary differential pressure.

Hose connection procedure

1. Push union nut and tensioning ring across hose.
2. Push cone part fully into the hose, see fig. 8.
3. Attach cone part with hose to the corresponding pump valve.
4. Tighten union nuts manually
- do not use tools!
5. Tighten up union nuts after 2-5 operating hours, if using PTFE gaskets!
6. Attach deaeration hose to the corresponding connection (see fig. 3) and run into a container or a collecting tray.

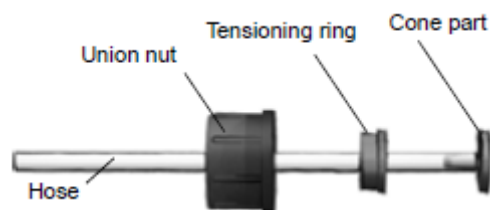


Fig. 8 Hydraulic connection

Note

Pressure differential between suction and discharge side must be at least 1 bar/14.5 psi!

Caution

Tighten up the dosing head screws once before commissioning and after 2-5 operating hours at 3 Nm.

Installation example

The pump offers various installation options. In the picture below, the pump is installed in conjunction with a suction line, level switch and multifunction valve on a Fink Chem + Tec GmbH & Co. KG tank

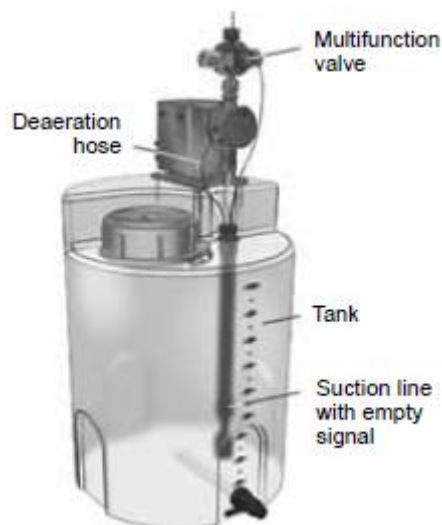


Fig. 9 Installation example

4.3 Electrical connection



Warning
The enclosure class (IP65/Nema 4X) is only guaranteed if lugs or protective caps or correctly installed!



Warning
The pump can start automatically when the mains voltage is switched on!
Do not manipulate mains plug or cable!

The rated voltage of the pump, see section 2.4 *Nameplate*, must conform to local conditions.

Signal connections

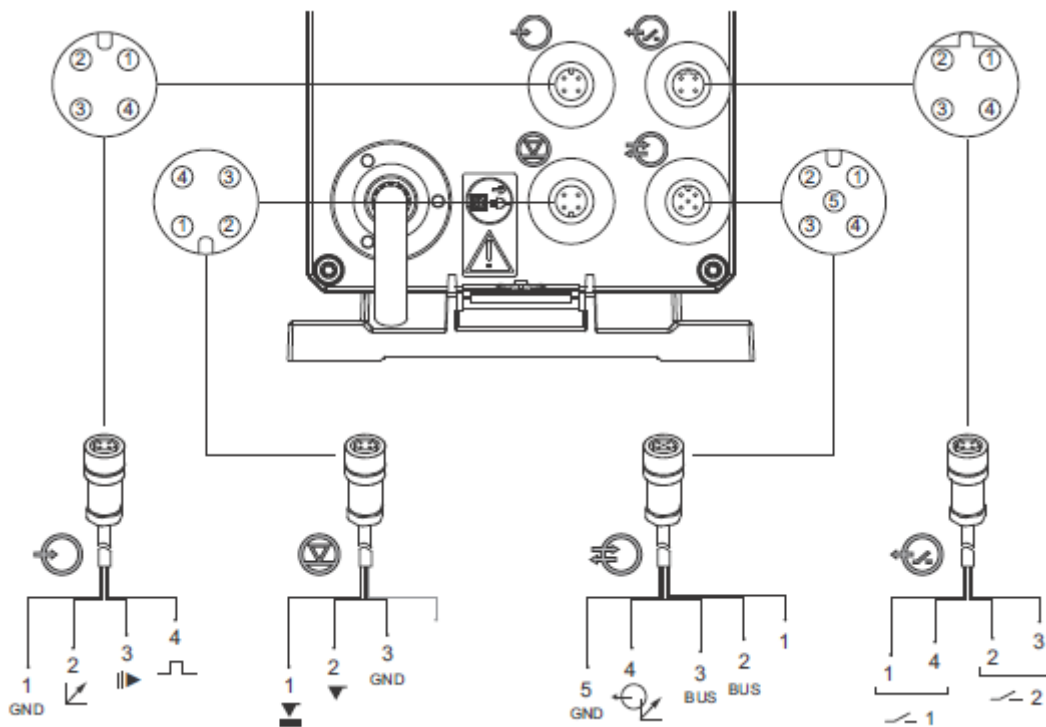


Fig. 10 Wiring diagram of the electrical connections

Analog, external stop and pulse input

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Analog	GND/ (-) mA	(+) mA			mA signal
External stop	GND		X		Pulse
Pulse	GND			X	Pulse

Level signals: empty and low-level signal

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Low-level signal	X		GND		Pulse
Empty signal		X	GND		Pulse

GENIbus, analog output

Function	Pins					Plug type
	1/brown	2/white	3/blue	4/black	5/yellow/ green	
GENIbus	+30 V	GENI bus TXD	GENI bus RXD		GND	Bus
Analog output				(+) mA	GND/ (-) mA	mA signal

Relay outputs

Function	Pins				Plug type
	1/brown	2/white	3/blue	4/black	
Relay 1	X			X	Pulse
Relay 2		X	X		Pulse

FlowControl signal connection

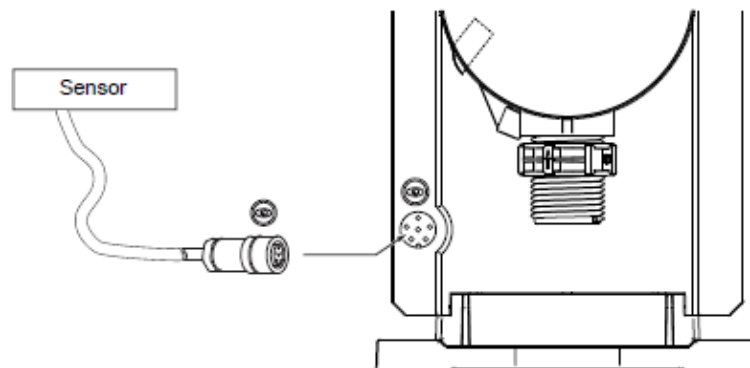



Fig.11 FlowControl connection

5. Commissioning


5.1 Setting the menu language

For description of control elements, see section 6.


1. Turn click wheel to highlight the clock symbol.

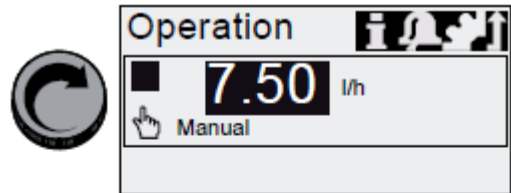


2. Press the click wheel to open the 'Setup' menu

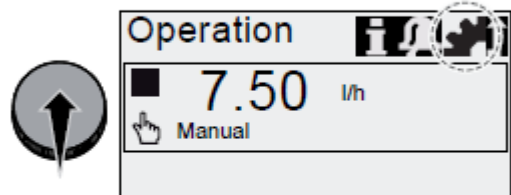

3. Turn the click wheel to highlight the 'Language' menu.

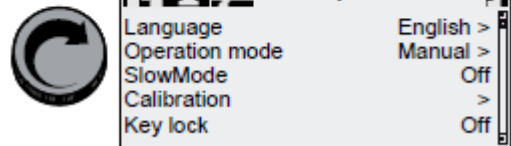


4. Press the click wheel to open the 'Language' menu.

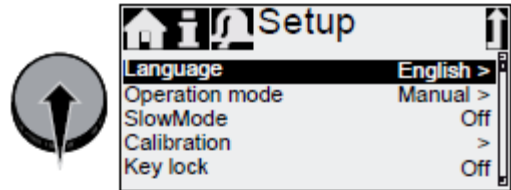

5. Turn the click wheel to highlight the desired language.



6. Press the click wheel to select the highlighted language.

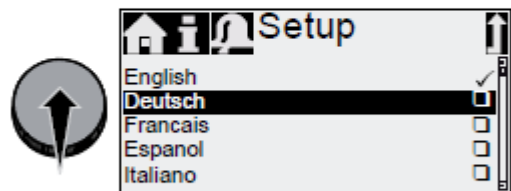

7. Press the click wheel again to confirm the 'Confirm settings' prompt and apply the setting.



Fig. 12 Set menu language

5.2 Deaerating the pump



Warning

The deaeration hose must be connected correctly and inserted into a suitable tank!

1. Open deaeration screw by approximately half turn.
2. Press and hold down the 100% key (deaeration key) until liquid flows continuously without any bubbles from the deaeration hose.
3. Close deaeration screw.

Note

Press the 100% key and simultaneously turn the click wheel clockwise to increase the duration of the process to up to 300 seconds. After setting the seconds, do not press the key any longer.

5.3 Calibrating the pump

The pump is calibrated in the factory for media with a viscosity similar to water at maximum pump backpressure (see section 3.1 *Technical data*).

If the pump is operated with a backpressure that deviates or if dosing a medium whose viscosity deviates, the pump must be calibrated.

For pumps with FCM control variant, it is not necessary to calibrate the pump if there is deviating or fluctuating backpressure as long as the 'AutoFlowAdapt' function has been enabled (see section 6.10 *AutoFlowAdapt*).

Requirements


- The hydraulics and electrics of the pump are connected (see section 4. *Assembly and installation*).
- The pump is integrated into the dosing process under operating conditions.
- The dosing head and suction hose are filled with dosing medium.
- The pump has been deaerated.


Calibration process – example for R033-7-16

1. Fill a measuring beaker with dosing medium.
Recommended filling volumes:

R033- Typ	7-16	12-10	17-7	30-4
Medium V1	0,3 l	0,5 l	1,0 l	1,5 l

2. Read off and note down the fill volume V1 (e.g. 300 ml).
3. Place the suction hose in the measuring beaker.

V₁ = 300 ml 

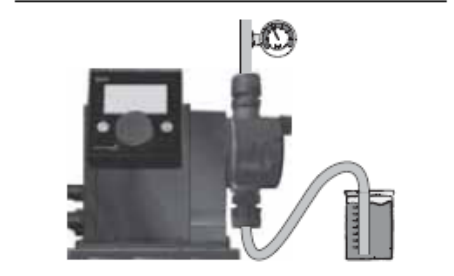


4. Start the calibration process in the 'Setup > Calibration' menu.




5. The pump executes 200 dosing strokes and displays the factory calibration value (e.g. 125 ml).




6. Remove the suction hose from the measuring beaker and check the remaining volume V2 (e.g. 170 ml).

V₂ = 170 ml 

7. From V1 and V2, calculate the actual dosed volume V_d=V1-V2 (e.g. 300 ml – 170 ml = 130 ml).

 V_d = V₁ - V₂ = 130 ml

8. Set and apply V_d in the calibration menu.
- The pump is calibrated.

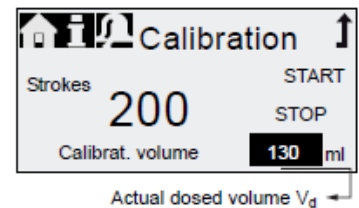

6. Operation

6.1 Operating elements

The pump control panel includes a display and the following control elements.

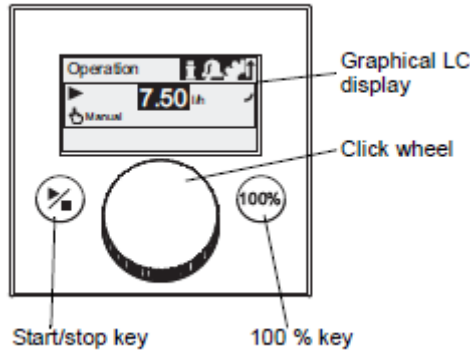


Fig. 13 Control panel

Key	Function
Start/stop key	Starting and stopping the pump.
100% key	The pump doses at maximum flow regardless of the operation mode.

Click wheel

The click wheel is used to navigate through the menus, select settings and confirm them. Turning the click wheel clockwise moves the cursor clockwise in increments in the display. Moving your finger anti-clockwise moves the cursor anti-clockwise.

6.2 Display and symbols

6.2.1 Navigation

In the 'Info', 'Alarm' und 'Setup' main menus, the options and submenus are displayed in the rows below. Use the 'Back' symbol to return to the higher menu level. The scroll bar at the right edge of the display indicates that here are further menu items which are not shown.

The active symbol (current cursor position) flashes. Press the click wheel to confirm your selection and open the next menu level. The active main menu is displayed as text, the other main menus are displayed a symbols. The position of the cursor is highlighted in black in the sub-menus.

When you position the cursor on a value and press the click wheel, a value is selected. Turning the click wheel clockwise increases the value, turning the click wheel anti-clockwise reduces the value. When you now press the click wheel, the cursor will be released again.

6.2.2 Operating states

The operating state of the pump is indicated by a symbol and display colour.

Display	Fault	Operating state		
White	-	Stop ■	Standby 	
Green	-			Running ▶
Yellow	Warning	Stop ■	Standby 	Running ▶
Red	Alarm	Stop ■	Standby 	

6.2.3 Sleep mode (energy-saving mode)

If in the 'Operation' main menu the pump is not operated for 30 seconds, the header disappears. After 2 minutes, the display switches to the 'Operation' main menu and the display brightness is reduced. This state will be cancelled when the pump is operated or a fault occurs.

6.2.4 Overview of display symbols

The following display symbols may appear in the menus.

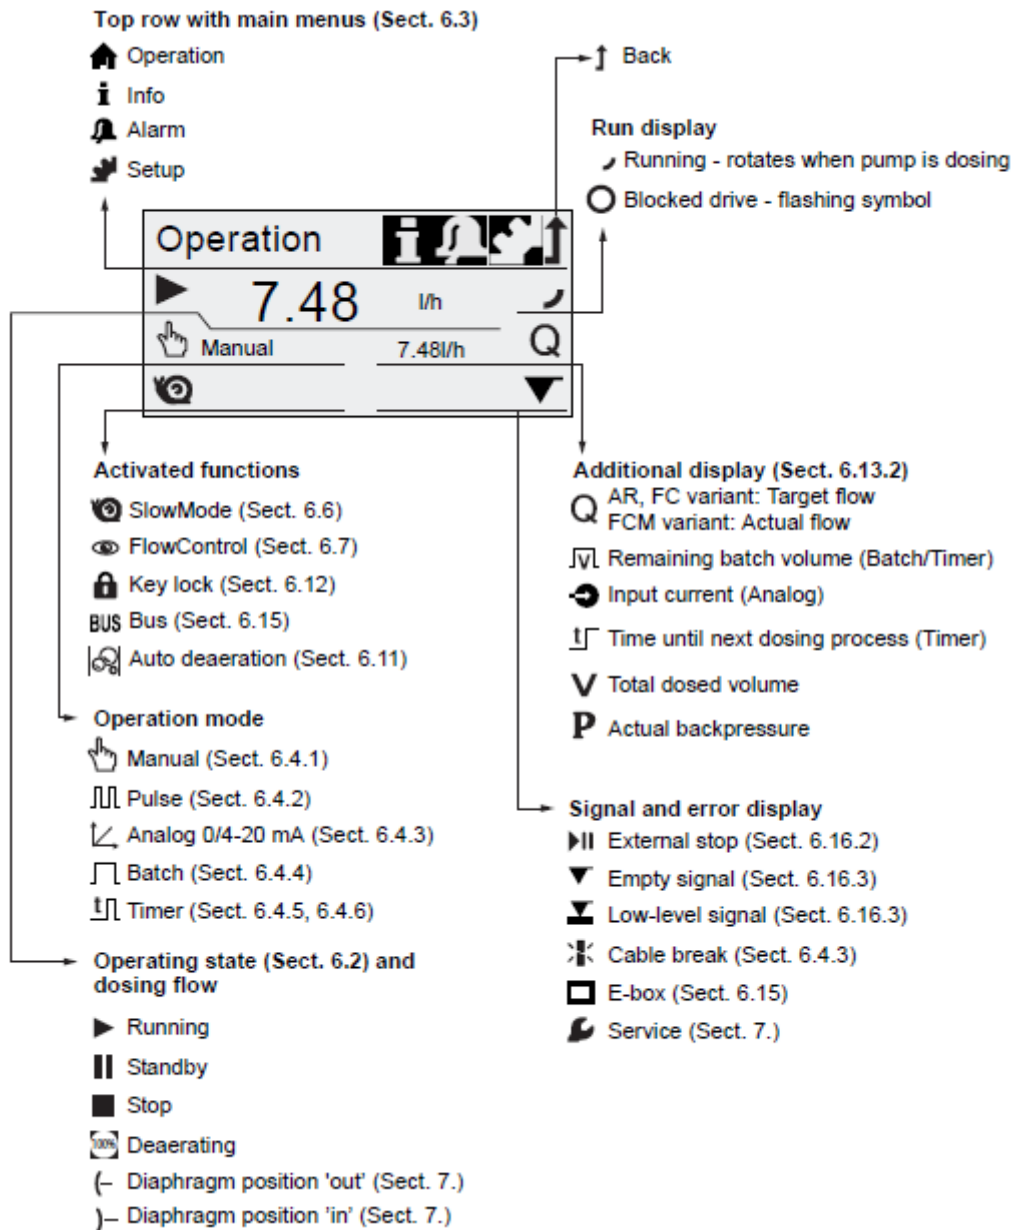



Fig. 14 Overview of display symbols

6.3 Main menus

The main menus are displayed as symbols at the top of the display. The currently active main menu is displayed as text.

6.3.1 Operation


Status information such as the dosing flow, selected operation mode and operating state is displayed in the 'Operation' main menu.

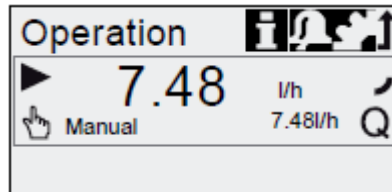

6.3.2 Info

You can find the date, time and information about the active dosing process, various counters, product data and the service system status in the 'Info' main menu. The information can be accessed during operation.

The service system can also be reset from here.

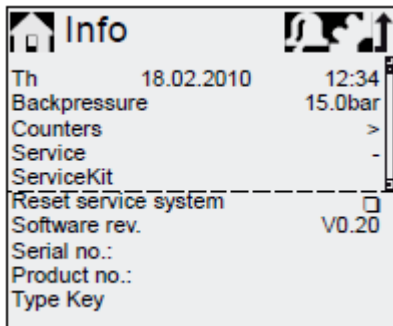


Counters

The 'Info > counters' menu contains the following counters:

Counters	resettable
Volume	
Total dosed volume [l] or US gallons	Yes
Operating hours	
Accumulated operating hours (pump switched on) [h]	No
Motor runtime	
Accumulated motor runtime [h]	No
Strokes	
Accumulated number of dosing strokes	No
Power on/off	
Accumulated frequency of switching mains voltage on	No

6.3.3 Alarm

You can view errors in the 'Alarm' main menu.

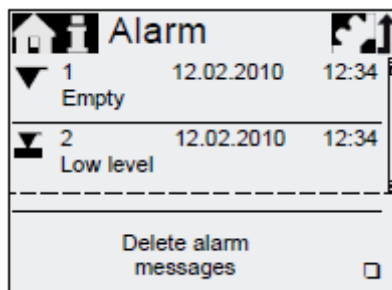

Up to 10 warnings and alarms, together with their date, time and cause, are listed in chronological order. If the list is full, the oldest entry will be overwritten, see Section 8. *Faults*.

6.3.4 Setup

The 'Setup' main menu contains menus for pump configuration. These menus are described in the following sections.

Setup		Section
Language	Deutsch >	5.1
Operation mode	Pulse >	6.4
Pulse memory *	<input type="checkbox"/>	6.4.2
Analog scaling *	>	6.4.3
Batch volume *	1.06 l	6.4.4
Dosing time *	7:50	6.4.4
Dos. Timer Cycle *	>	6.4.5
Dos. Timer Week *	>	6.4.6
Analog output	Actual flow >	6.5
SlowMode	Off >	6.6
FlowControl active *	<input type="checkbox"/>	6.7
FlowControl *	>	6.7
Pressure monitoring *	>	6.8
AutoFlowAdapt *	<input type="checkbox"/>	6.10
Auto deaeration	<input type="checkbox"/>	6.11
Calibration	>	5.3
Key lock	Off >	6.12
Display	>	6.13
Time+date	>	6.14
Bus *	>	6.15
Inputs/Outputs	>	6.16
Basic settings	>	6.17

*These submenus are only displayed for specific default settings and control variants. The contents of the 'Setup' menu also vary depending on the operation mode.

6.4 Operation modes

Six different operation modes can be set in the 'Setup > Operation mode' menu.

- **Manual**, see section 6.4.1
- **Pulse**, see section 6.4.2
- **Analog 0-20 mA**, see section 6.4.3
- **Analog 4-20 mA**, see section 6.4.3
- **Batch**, see section 6.4.4
- **Dosing timer, cycle** see section Kap. 6.4.5
- **Dosing timer, week** see section Kap. 6.4.6

6.4.1 Manual

In this operation mode, the pump constantly doses the dosing flow set with the click wheel. The dosing flow is set in l/h or ml/h. The pump automatically switches between the units. Alternatively, the display can be reset to US units (gph).

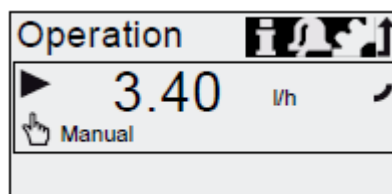


Fig. 15 Manual mode

The setting range depends on the pump type:

Type	Setting range*	
	l/h	gph
R033-7-16	0,0025 – 7,5	0,0007 – 2,0
R033-12-10	0,012 – 12,0	0,0031 – 3,1
R033-17-7	0,017 – 17,0	0,0045 – 4,5
R033-30-4	0,03 - 30	0,0080 – 8,0

*When the SlowMode function is active, the maximum dosing flow is reduced, see section 3.1 Technical data.

6.4.2 Pulse

In this operation mode, the pump doses the set dosing volume for each incoming (potential-free) pulse, e.g. from a water meter. There is no direct connection between incoming pulses and dosing strokes. The pump automatically calculates the optimum stroke frequency for dosing the set volume per pulse.

The calculation is based on:

- the frequency of external pulses
- the set dosing volume/pulse.

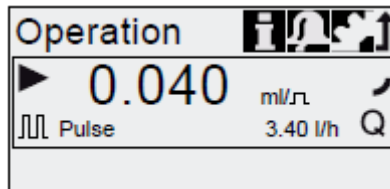


Fig. 16 Pulse operation mode

The dosing volume per pulse is set in ml/pulse using the click wheel. The setting range for the dosing volume depends on the pump type

Type	Setting range/pulse
R033-7-16	1,3µl - 12,8 ml
R033-12-10	2,6µl - 25,8 ml
R033-17-7	2,7µl - 26,8 ml
R033-30-4	5,8µl - 58,4 ml

The frequency of incoming pulses is multiplied by the set dosing volume. If the pump receives more pulses than it can process at the maximum dosing flow, it runs at the maximum stroke frequency in continuous operation. Excess pulses will be ignored if the memory function is not enabled.

Memory- function

When the 'Setup > Pulse memory' function is enabled, up to 65,000 unprocessed pulses can be saved for subsequent processing.

Note

The contents of the memory will be deleted when:

- switching off the power supply
- switching the operating mode
- the pump is interrupted (e.g. alarm, external stop.)

6.4.3 Analog 0/4 – 20 mA

In this operation mode, the pump doses according to the external analog signal. The dosing volume is proportional to the signal input value in mA.

Operation mode	Input value	Dosing flow
4-20 mA	≤ 4.1 mA	0 %
	≥ 19.8 mA	100 %
0-20 mA	≤ 0.1 mA	0 %
	≥ 19.8 mA	100 %

If the input value in operation mode 4-20 mA falls below 2 mA, an alarm is displayed and the pump stops. A cable break or signal transmitter error has occurred. The 'Cable break' symbol is displayed in the 'Signal and error display' area of the display.

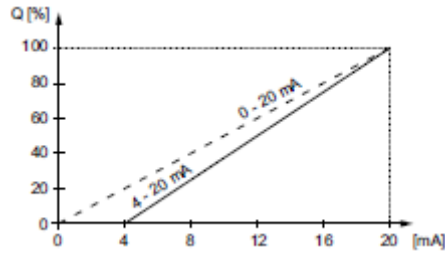


Fig. 17 Analog scaling

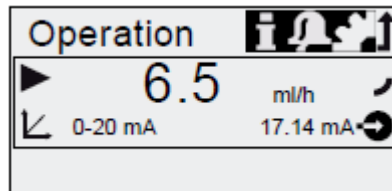


Fig. 18 Analog operation mode

Set analog scaling

Analog scaling refers to the assignment of the current input value to the dosing flow. Analog scaling passes through the two reference points (I_1/Q_1) and (I_2/Q_2), which are set in the 'Setup > Analog scaling' menu. The dosing flow is controlled according to this setting.

Example 1 (R033-7-16)

Analog scaling with positive gradient:

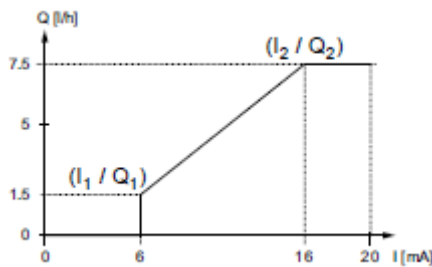


Fig. 19 Analog scaling with pos. gradient

In example 1, the reference points $I_1=6$ mA, $Q_1=1,5$ l/h and $I_2=16$ mA, $Q_2=7,5$ l/h have been set.

From 0 to 6 mA analog scaling is described by a line that passes through $Q=0$ l/h, between 6 mA and 16 mA it rises proportionally from 1.5 l/h to 7.5 l/h and from 16 mA onwards it passes through $Q=7.5$ l/h.

Example 2 (R033-7-16)

Analog scaling with negative gradient (Operation mode 0-20 mA):

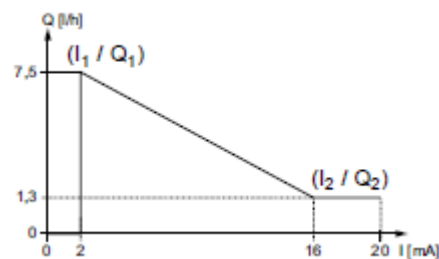


Fig. 20 Analog scaling with neg. gradient.

In example 2, the reference points $I_1=2$ mA, $Q_1=7,5$ l/h and $I_2=16$ mA, $Q_2=1,3$ l/h have been set.

From 0 to 2 mA analog scaling is described by a line that passes through $Q=0$ l/h, between 2 mA and 16 mA it drops proportionally from 7.5 l/h to 1.3 l/h and from 16 mA onwards it passes through $Q_2=1.3$ l/h.

Set analog scaling in the 'Operation' menu

Analog scaling can also be modified after a security prompt directly in the 'Operation' menu. This is how the dosing flow is directly modified for the current flow input value.

Caution Please observe that changes also have a direct effect on point I_2/Q_2 (see fig. 21)!

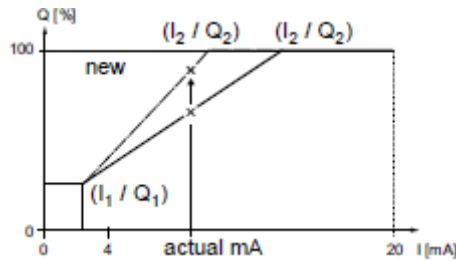


Fig. 21 Set analog scaling ('Operation' menu)

6.4.4 Batch (pulse-based)

In this operation mode, the pump doses the set batch volume in the set dosing time (T_1). A batch is dosed with each incoming pulse.

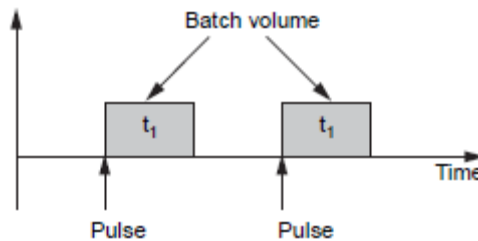


Fig. 22 Batch (pulse-based)

The setting range depends on the pump type:

Type	Setting range per batch		
	from (ml)	to(l)	Resolution* (ml)
R033-7-16	0,74	999	0,0925
R033-12-10	1,45	999	0,1813
R033-17-7	1,55	999	0,1938
R033-30-4	3,10	999	0,3875

*Thanks to the digital motor control, dosing quantities with a resolution of up to 1/8 of the dosing stroke volume can be dosed.

The batch volume (e. g. 75 ml) is set in the 'Setup > Batch volume' menu. The minimum dosing time required for this (e. g. 32 seconds) is displayed and can be increased.



Fig. 23 Batch mode

If the batch volume is modified, the dosing time resets to the minimum dosing time. Signals received during a batch process or an interruption (e. g. alarm, external stop) will be ignored. If the pump is restarted following an interruption, the next batch volume is dosed on the next incoming pulse.

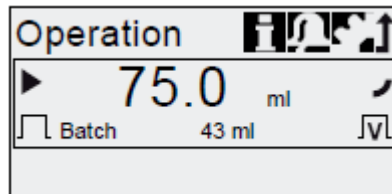


Fig. 24 Batch mode

In the 'Operation' menu, the total batch volume (e. g. 75 ml) and the remaining batch volume still to be dosed (e.g. 43 ml) are shown in the display.

6.4.5 Dosing timer, cycle

In this operation mode, the pump doses the set batch volume in regular cycles. Dosing starts when the pump is started after a singular star delay. The setting range for the batch volume corresponds to the values in section 6.4.4 *Batch (pulse-based)*.

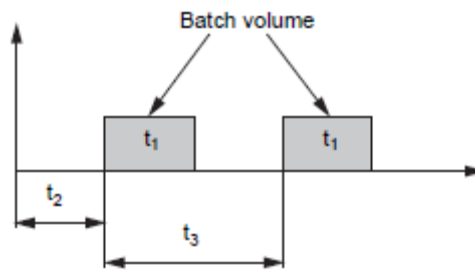


Fig. 25 Dosing Timercycle

T1	Dosing time
T2	Start delay
T3	Cycle time

The cycle time must be longer than the dosing time, otherwise the following dosing will be ignored. In the event of an interruption (e. g. interruption of the mains voltage, external stop), the dosing will be stopped while the time continues running. After suspending the interruption, the pump will continue to dose according to the actual timeline position.

The following settings are required in the 'Setup > Dos. Timer Cycle' menu:



Fig. 26 Dos. Timer Cycle mode

The batch volume to be dosed (e. g. 125 ml) is set in the 'Setup > Dos. Timer Cycle' menu. The minimum dosing time required for this (e. g. 1:54) is displayed and can be increased.

The total batch volume (e. g. 125 ml) and the remaining batch volume still to be dosed are displayed in the 'Operation' menu. During breaks in dosing, the time until the next dosing process (e. g. 1:21) is displayed.

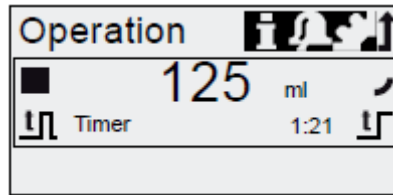


Fig. 27 Dos. Timer Cycle mode

6.4.6 Dosing timer, week

In this operation mode, up to 16 dosing procedures are defined for a week. These dosing procedures may take place regularly on one of several week days. The setting range for the batch volume corresponds to the values in section 6.4.4 *Batch* (pulse-based).

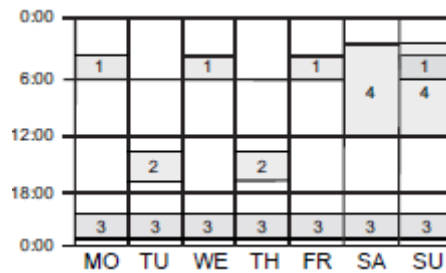


Fig. 28 Week timer dosing

Note If several procedures overlap, the process with the higher dosing flow has priority!

In the event of an interruption (e. g. disconnection of the mains voltage, external stop), the dosing is stopped while the time continues running. After suspending the interruption, the pump continues to dose according to the actual timeline position.

The following settings are required in the 'Setup > Dos. Timer Week' menu for each dosing procedure:



Fig. 29 Setting the timer

The batch volume (e. g. 80.5 ml) is set in the 'Setup > Dos. Timer Week' menu. The minimum dosing time required for this (e. g. 0:34) is displayed and can be increased.

In the Operation mode, the total batch volume (e. g. 80.5 ml) and the remaining batch volume to be dosed is displayed. During breaks in dosing, the time (e. g. 43:32) until the next dosing is displayed.

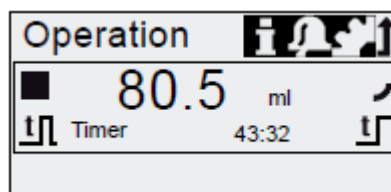


Fig. 30 Weekly timer dosing/break in dosing

6.5 Analog output

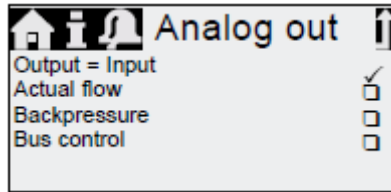


Fig. 31 Configure analog output

The analog output of the pump is parametrised in the 'Setup > Analog output' menu. The following settings are possible:

Setting	Description Analog output signal	Control variant		
		FCM	FC	AR
Output=Input	The analog input signal is mapped 1:1 to the analog output (e. g. to control several pumps using one signal)	X	X	X
Actual flow	Current actual flow - 0/4 mA = 0% - 20 mA = 100% See section 6.8.2 Calibration of pressure sensor	X	X*	X*
Backpressure	Backpressure, measured in the dosing head - 0/4 mA = 0% - 20 mA = 100% See section 6.8 Pressure monitoring	X	X	
Bus control	Enabled by command in Bus control, see section 6.15 Bus communication	X	X	X

*Output signal is based on motor speed and pump status (target flow). Wiring diagram see section 4.3 Electrical connection.

Note In all modes, the analog output has a range of 4-20 mA. Exception: Operation mode 0-20 mA. Here, the analog output range is 0-20 mA.

6.6 SlowMode

When the 'SlowMode' function is enabled, the pump slows down the suction stroke. The function is enabled in the 'Setup > SlowMode' menu and is used to prevent cavitation in the following cases:

- for dosing media with a higher viscosity
- for degassing dosing media
- for long suction lines
- for large suction lift

In the 'Setup > SlowMode' menu, the speed of the suction stroke can be reduced to 50% or 25%.

Caution Enabling the 'SlowMode' function reduces the maximum dosing flow of the pump to the set percentage value!

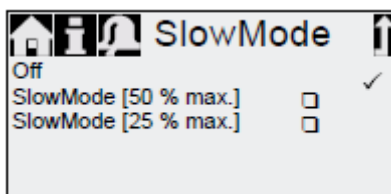


Fig. 32 SlowMode menu

6.7 Flow Control

FC/FCM control variant.

This function is used to monitor the dosing process. Although the pump is running, various influences e. g. air bubbles, can cause a reduced flow or even stop the dosing process. In order to guarantee optimum process safety, the enabled FlowControl function directly detects and indicates the following errors and deviations:

- Overpressure
- Damaged discharge line
- Air in the dosing chamber
- Cavitation
- Suction valve leakage
- Discharge valve leakage

The occurrence of a fault is indicated by the 'eye' symbol flashing. The faults are displayed in the 'Alarm' menu (see section 8. *Faults*).

FlowControl works with a maintenance-free sensor in the dosing head. During the dosing process, the sensor measures the current pressure and continuously sends the measured value to the microprocessor in the pump. An internal indicator diagram is created from the current measured values and the current diaphragm position (stroke length). Causes for deviations can be identified immediately by aligning the current indicator diagram. Air bubbles in the dosing head reduce e. g. the discharge phase and consequently the stroke volume (see fig. 33).

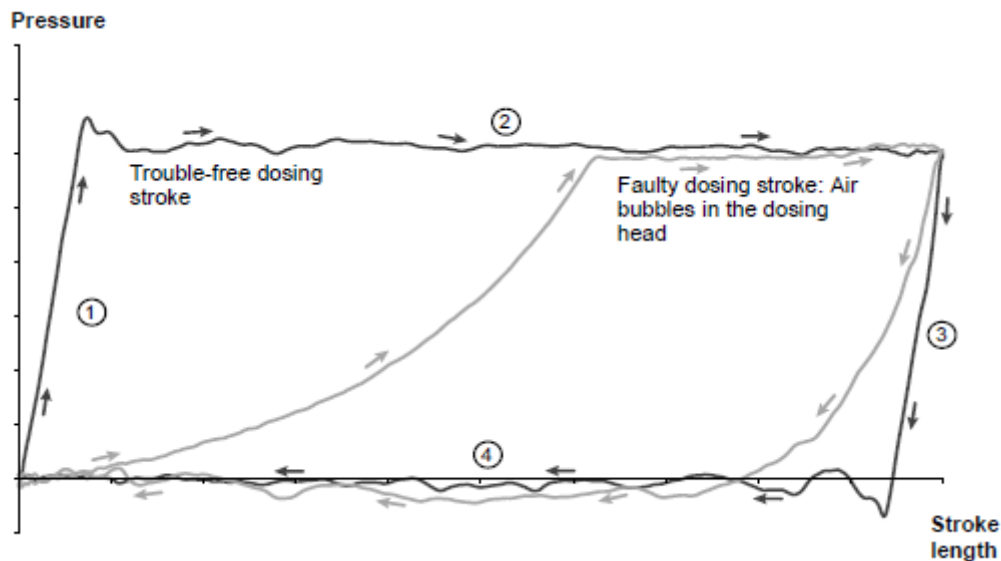


Fig. 33 Indicator diagram

- 1) Compression phase
- 2) Discharge phase
- 3) Expansion phase
- 4) Suction phase

Setting FlowControl

The 'FlowControl' function is set using the two parameters 'Sensitivity' and 'Delay' in the 'Setup > FlowControl' menu.

Sensitivity

In 'Sensitivity' the deviation in stroke volume, which will result in an error message, is set in percent.

Sensitivity	Deviation
Low	approx. 70%
Medium	approx. 50%
High	approx. 30%

Delay

The 'Delay' parameter is used to define the time period until an error message is generated: 'short' 'medium' or 'long'. The delay depends on the set dosing flow and therefore cannot be measured in strokes or time.

6.8 Pressure monitoring

FC/FCM control variant.

A pressure sensor monitors the pressure in the dosing head. If the pressure during the discharge phase falls below 2 bar, a warning is generated (pump continues running). If in the 'Setup > Pressure monitoring' menu the function 'Min. pressure alarm' is activated, an alarm is generated and the pump is stopped.

If the pressure exceeds the cut-off pressure set in the 'Setup > Pressure monitoring' menu, the pump is shut down, enters the standby state and indicates an alarm.

Caution The pump restarts automatically once the backpressure falls below the cut-off pressure!

6.8.1 Pressure setting ranges

Type	Fixed min. pressure (bar)	Settable max. pressure (bar)
R033-7-16	< 2	3...17
R033-12-10	< 2	3...11
R033-17-7	< 2	3 8
R033-30-4	< 2	3 5

Caution The pressure measured in the dosing head is slightly higher than the actual system pressure. Therefore the cut-off pressure should be set min. 0.5 bar higher than the system pressure.



Warning
Install a pressure-relief valve in the pressure line to provide protection against impermissibly high pressure!

6.8.2 Calibration of pressure sensor


The pressure sensor is calibrated in the factory. As a rule, it does not need to be re-calibrated. If specific circumstances (e. g. pressure sensor exchange, extreme air pressure values at the location of the pump) necessitate a calibration, the sensor can be calibrated as follows.

1. Set pump to 'Stop' operational state.
2. Make system pressureless and flush.
3. Dismantle suction line and suction valve.

Caution Calibrating when the suction valve is installed produces incorrect calibration and can cause personal injuries and damage to property!
Only carry out a calibration if this is technically required!

4. Proceed as described below to calibrate:

Plug in pressure sensor plug or select
'Setup > FlowControl active' menu

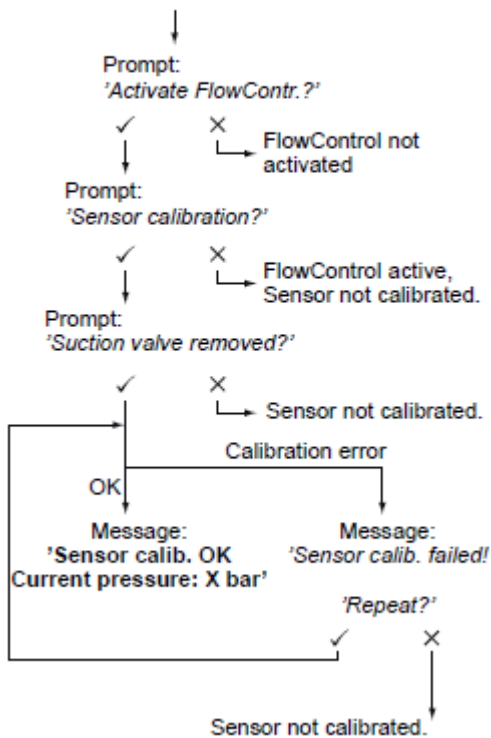

If a calibration is not successfully possible, check plug connections, cable and sensor and replace defective parts where necessary.

6.9 Flow measurement

FCM control variant.

The pump accurately measures the actual flow and displays it. Via the 0/4 – 20 mA analog output, the actual flow signal can easily be integrated into an external process control without additional measuring equipment (see section 6.5 Analog output).

The flow measurement is based on the indicator diagram as described in section 6.7 *FlowControl*. The accumulated length of the discharge phase multiplied by the stroke frequency produces the displayed actual flow. Faults e. g. air bubbles or backpressure that is too low result in a smaller or larger actual flow. When the '*AutoFlowAdapt*' function is activated (see section 6.10 *AutoFlowAdapt*), the pump compensates for these influences by correction of the stroke frequency.

Note **Strokes which cannot be analysed (partial strokes, pressure differential which is too low) are provisionally calculated based on the setpoint value and displayed.**

6.10 AutoFlowAdapt

FCM control variant.

The '*AutoFlowAdapt*' function is activated in the '*Setup*' menu. It detects changes in various parameters and responds accordingly in order to keep the set target flow constant.

Note **Dosing accuracy is increased when '*AutoFlowAdapt*' is activated.**

This function processes information from the pressure sensor in the dosing head. Errors detected by the sensor are processed by the software. The pump responds immediately regardless of the

operation mode by adjusting the stroke frequency or where necessary compensating for the deviations with a corresponding indicator diagram.

If the target flow cannot be achieved by the adjustments, a warning is issued.

'AutoFlowAdapt' operates on the basis of the following functions:

- FlowControl: malfunctions are identified (see section 6.7 FlowControl).
- Pressure monitoring: pressure fluctuations are identified (see section 6.8 Pressure monitoring)
- Flow measurement: deviations from the target flow are identified (see section 6.8.2 Calibration of pressure sensor).

Examples of 'AutoFlowAdapt'

Pressure fluctuations

The dosing volume decreases as backpressure increases and conversely the dosing volume increases as the backpressure decreases.

The 'AutoFlowAdapt' function identifies pressure fluctuations and responds by adjusting the stroke frequency. The actual flow is thus maintained at a constant level.

Air bubbles

The 'AutoFlowAdapt' function identifies air bubbles, The pump responds with a special indicator diagram due to which the air bubbles are removed as a top priority (deaeration).

If the air bubbles have not been eliminated after a maximum of 60 strokes, the pump switches to the 'Air bubble' warning status and returns to the normal indicator diagram.

6.11 Auto deaeration



Dosing degassing media can result in air pockets in the dosing head during breaks in dosing. This can result in no medium being dosed when restarting the pump. The 'Setup > Auto deaeration' function performs pump deaeration automatically at regular intervals. Software-controlled diaphragm movements encourage any bubbles to rise and gather at the discharge valve so that they can be removed on the next dosing stroke.

The function works:

- when the pump is not in the 'Stop' mode.
- during breaks in dosing (e. g. External stop, no incoming pulses, etc.).

Note

Low volumes can be displaced into the discharge line by the diaphragm movements. When dosing strongly degassing media, this is however virtually impossible.

6.12 Key lock



The key lock is set in the 'Setup > Key lock' menu by entering a four-digit code. It protects the pump by preventing changes to settings. Two levels of key lock can be selected:

Level	Description
Settings	All settings can only be changed by entering the lock code. The start/stop key and the 100% key are not locked.
Settings + keys	The start/Stop key and the 100% key and all settings are locked.

It is still possible to navigate in the 'Alarm' and 'Info' main menu and reset alarms.

Temporary deactivation

If the key lock function is activated but settings need to be modified, the keys can be unlocked temporarily by entering the deactivation code. If the code is not entered within 10 seconds, the display automatically switches to the 'Operation' main menu. The key lock remains active.

Deactivation

The key lock can be deactivated in the 'Setup > Key lock' menu via the 'Off' menu point. The key lock is deactivated after the general code '2583' or a predefined custom code has been entered.

6.13 Display Setup

Use the following settings in the 'Setup > Display' menu to adjust the display properties:

- Units (metric/US)
- Display contrast
- Additional display

6.13.1 Units

Metric units (liters/milliliters/bar) or US units (US gallons/PSI) can be selected. According to the operation mode and menu, the following units of measurement are displayed:

Operation mode/ function	Metric units	US units
Manual control	ml/h or l/h	gph
Pulse control	ml/□	ml/□
0/4-20 mA Analogue control	ml/h or l/h	gph
Batch (pulse- or timer- controlled)	ml or l	gal
Calibration	ml	ml
Volume counter	l	gal
Pressure monitoring	bar	psi

6.13.2 Additional display

Additional display provides additional information about the current pump status. The value is shown in the display with the corresponding symbol.

In 'Manual' mode the 'Actual flow' information can be displayed with $Q = 1.28 \text{ l/h}$ (see fig. 34).

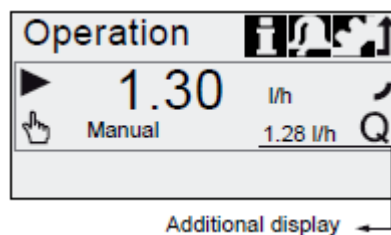


Fig. 34 Display with additional display

The additional display can be set as follows:

Setting	Description
	<i>Depending on the operation mode:</i>
	Q Actual flow (manual, pulse) ¹⁾
	Q Target flow (pulse)
Default display	↻ Input current (analog)
	√ Remaining batch volume (Batch, Dos. Timer)
	⌋ Period until next dosing (Dos. Timer)
Dosed volume	V Dosed vol. since last reset (see <i>Counters</i> on page 21)
Actual flow	Q Current actual flow ¹⁾
Backpressure	P Current backpressure in the dosing head ²⁾

1) only R033-FCM control variant

2) only R033-FCM/FC control variant

6.14 Time/ Date

The time and date can be set in the 'Setup > Time + date' menu.

Caution The conversion between summer and winter time does not take place automatically!

6.15 Bus communication BUS

The pump is supplied with an integrated module for GENIbus communication. The pump identifies the bus control after connecting to the corresponding signal input. The "Activate Genibus"? prompt is displayed. After confirmation, the 'Bus' submenu appears in the 'Setup' menu.



Fig. 35 'Setup > Bus' menu

The corresponding symbol appears in the 'Activated functions' area in the 'Operation' menu.

The pump can also be integrated into a Profibus DP network using the additional E-box module (retrofitting possible).

The bus communication enables remote monitoring and setting of the pump via a fieldbus system.

6.16 Inputs/outputs

In the 'Setup > Inputs/outputs' menu, you can configure the two outputs

'Relay 1+2' and the signal inputs 'External stop', 'Empty signal' and 'Low level signal':

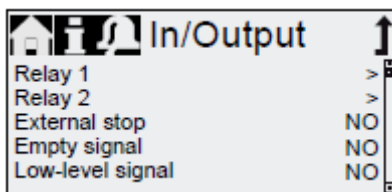


Fig. 36 'Setup > Inputs/outputs' menu

6.16.1 Relay outputs

The pump can switch two external signals using installed relays. The relays are switched by potential free pulses. The connection diagram of the relays is shown in section 4.3 *Electrical connection*. Both relays can be allocated with the following signals.

Relay 1 signal	Relay 2 signal	Description
Alarm*	Alarm	Display red, pump stopped (e.g. empty signal, etc.)
Warning*	Warning	Display yellow, pump is running (e.g. low-level signal, etc.).
Stroke signal	Stroke signal*	Each full stroke
Pump dosing	Pump dosing	Pump running and dosing
Bus control	Bus control	Activated by a command in the bus communication
	Timer, cycle	See following section
	Timer, week	See following section

Contact type		
NO*	NO*	Normally open contact
NC	NC	Normally closed contact

*Factory setting

Timer, cycle (relay 2)

For the 'Relay 2 > Timer cycle' function, set the following parameters:

- Dosing time (t_1)
- Start delay (t_2)
- Cycle time (t_3)

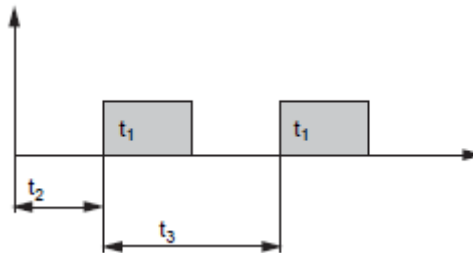


Abb. 37 Diagram

Timer Week (Relay 2)

- This function saves up to 16 relay on-times for a week. The following settings can be made for each relay switching operation in the 'Relay 2 > Timer Week' menu:
- Procedure (No.)
- On-time (duration)
- Start time
- Weekdays.

6.16.2 External Stop ▶||

The pump can be stopped via an external pulse, e.g. from a control room. When activating the external stop pulse, the pump switches from the operational state 'Running' into the operational state 'Standby'. The corresponding symbol appears in the Signal/error display (see section 6.2.2 Operating states).

Caution

Frequent disengagement from the mains voltage, e.g. via a relay, can result in damage to the pump electronics and to the breakdown of the pump. The dosing accuracy is also reduced as a result of internal start procedures.

Do not control the pump via the mains voltage for dosing purposes!

Only use the 'External stop' function to start and stop the pump!

The contact type is factory-set to closing contact (=>NO). In the 'Setup > Inputs/outputs > External stop' menu, the setting can be changed to opening contact (=>NC)

6.16.3 Empty and low-level signals ▼ ▾

In order to monitor the fill level in the tank, a dual-level control unit can be connected to the pump.

The pump responds to the signals as follows:

Fill level sensor	Pump status
Low level	<ul style="list-style-type: none"> • Display is yellow • ▼ flashes • Pump continues running
Empty	<ul style="list-style-type: none"> • Display is red • ▼ flashes • Pump stops

Both signal inputs are allocated to the closing contact (=>NO) in the factory. They can be re-allocated in the 'Setup > Inputs/outputs' menu to opening contact (=>NC).

6.17 Basic settings

All settings can be reset to the settings default upon delivery in the 'Setup > Basic settings' menu. Selecting 'Save customer settings' saves the current configuration to the memory. This can then be activated using 'Load customer settings'.

The memory always contains the previously saved configuration. Older memory data is overwritten.

7. Service

In order to ensure a long service life and dosing accuracy, wearing parts such as diaphragms and valves must be regularly checked for signs of wear. Where necessary, replace worn parts with original spare parts made from suitable materials.

Should you have any questions, please contact with us.



Warning

If the diaphragm leaks or is broken, dosing liquid will escape from the discharge opening on the dosing head (see fig. 3).

Take suitable precautions to prevent harm to health and damage to property caused by escaping dosing liquid!

Check daily whether liquid is escaping from the discharge opening!

7.1 Service system

According to the motor runtime service requirements will appear. Service requirements appear regardless of the current operational state of the pump and do not affect the dosing process.

Service requirement	Motor runtime (h)*	Time interval (months)*
'Service soon'	7.500	23
'Service now'	8.000	24

*Since the last service system reset

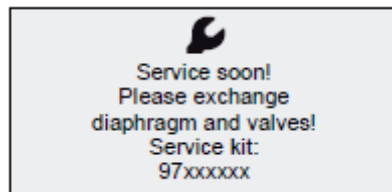


Fig. 38 'Service soon'

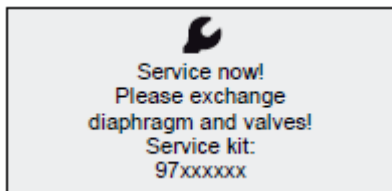



Fig. 39 'Service now'

The service requirement signals when the replacement of wearing parts is due and displays the number of the service kit. Press the click wheel to temporarily hide the service prompt. When the "Service now" message appears (displayed daily), the pump must be serviced immediately.

To signalise in the 'Operation' menu, the Symbol  appears in the 'Signal/error display' area of the display. The number of the service kit required is also displayed in the 'Info' menu.

For media which result in increased wear, the service interval must be shortened.

7.2 Perform service

Only spare parts and accessories from Fink Chem + Tec OHG should be used for maintenance. The usage of non-original spare parts and accessories renders any liability for resulting damages null and void.




Warning
When dosing dangerous media, observe corresponding precautions in the safety data sheets!
Risk of chemical burns!
Wear protective clothing (gloves and goggles) when working on the dosing head, connections or lines!
Do not allow any chemicals to leak from the pump. Collect and dispose of all chemicals correctly!

Caution

Before any work to the pump, the pump must be disconnected from the mains. The system must be pressureless!

7.2.1 Dosing head overview

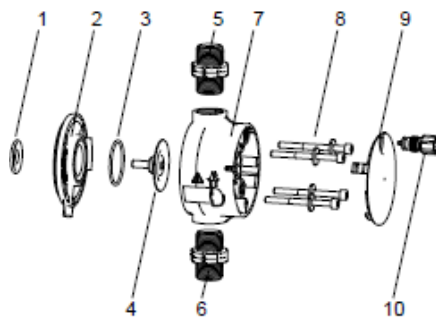

1	Safety diaphragm
2	Flange
3	O-ring
4	Diaphragm
5	Valve on discharge side
6	Valve on suction side
7	Dosing head
8	Screws with discs
9	Cover
10	Deaeration valve

Fig. 40 Dosing head, exploded view

7.2.2 Dismantling the diaphragm and valves

1. Make system pressureless.
2. Empty dosing head before maintenance and flush it if necessary.
3. Set pump to 'Stop' ■ operational state using the 'Start/stop key'
4. Press the 'Start/stop' and '100%' keys at the same time to put the diaphragm into 'out' position.
 - Symbol I- must be displayed as the operational state (see fig. 13).
5. Take suitable steps to ensure that the returning liquid is safely collected.
6. Dismantle suction, pressure and deaeration hoses.
7. Dismantle valves on suction and discharge side (5, 6).
8. Remove the cover (9).
9. Loosen screws (8) on the dosing head (7) and remove the screws and discs.
10. Remove the dosing head (7).
11. Unscrew diaphragm (4) counter-clockwise and remove with flange (2)

7.2.3 Reassembling the diaphragm and valves

1. Attach flange (2) correctly and screw on new diaphragm (4) clockwise.
 - Make sure that the O-ring (3) is seated correctly!
2. Press the 'Start/stop' and '100%' keys at the same time to put the diaphragm into 'in' position.
 - Symbol I- must be displayed as the operational state (see fig. 13).
3. Attach the dosing head (7).
4. Install screws with discs (8) and cross-tighten.
 - Torque: 3 Nm.
5. Attach the cover (9).
6. Install new valves (5, 6).
 - Do not interchange valves and pay attention to direction of arrow.
7. .Connect suction, pressure and deaeration hose (see section 4.2 Hydraulic connection)

8. Press the 'Start/Stop' key to leave the service mode.
9. Deaerate dosing pump (see section 5.2 *Deaerating the pump*).
10. Please observe the notes on commissioning in section 5. *Commissioning*!

7.3 Resetting the service system

After performing the service, the service system must be reset using the 'Info > Reset service system' function.

7.4 Repairs



Warning

The pump housing must only be opened by personnel authorised by Fink Chem + Tec OHG!

Repairs must only be carried out by authorised and qualified personnel!

Switch off the pump and disconnect it from the voltage supply before carrying out maintenance work and repairs!

After consulting Fink Chem + Tec OHG, please send the pump, together with the safety declaration completed by a specialist, to Fink Chem + Tec OHG. The safety declaration can be found at the end of these instructions. It must be copied, completed and attached to the pump.

Caution If the pump has been used to dose toxic liquids or liquids hazardous to health, the pump must be cleaned prior to dispatch!

If the above requirements are not met, the Fink Chem + Tec OHG may refuse to accept delivery of the pump. The shipping costs will be charged to the sender.

8. Faults

In the event of faults in the dosing pump, a warning or an alarm is triggered. The corresponding fault symbol flashes in the 'Operation' menu, see section 8.1 *List of faults*. The cursor jumps to the 'Alarm' main menu symbol. Press the click wheel to open the 'Alarm' menu and, where necessary, faults to be acknowledged will be acknowledged.


A yellow display indicates a warning and the pump continues running.

A red display indicates an alarm and the pump is stopped.

The last 10 faults are stored in the 'Alarm' main menu. When a new fault occurs, the oldest fault is deleted.

The two most recent faults are shown in the display, you can scroll through all the other faults.

The time and cause of the fault are displayed.

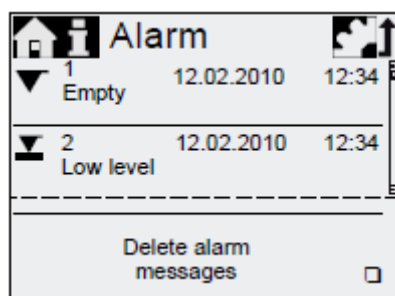




The list of faults can be deleted at the end of the list.

If there is a service requirement, this appears when the 'Alarm' menu is opened. Press the click wheel to temporarily close the service prompt (see section 7.1 *Service system*).

8.1 List of faults

8.1.1 Faults with error message

Display in the 'Alarm' menu		Possible cause	Possible remedy
	Empty (Alarm)	<ul style="list-style-type: none"> Dosing medium tank empty 	<ul style="list-style-type: none"> Fill tank Check contact setting (NO/NC)
	Low level (Warning)	<ul style="list-style-type: none"> Dosing medium tank almost empty 	
	Overpressure (Alarm)	<ul style="list-style-type: none"> Discharge valve blocked Isolating valve in discharge line closed Pressure peaks due to high viscosity 'Max. pressure' set too low (see section 6.8 Pressure monitoring) 	<ul style="list-style-type: none"> Replace valve if necessary (see section 7.2 <i>Perform service</i>) Check flow direction of valves (arrow) and correct if necessary. Open the isolating valve (on the discharge side). Enlarge diameter of discharge line. Change pressure setting (see section 6.8 <i>Pressure monitoring</i>).
	Backpressure low (Warning/alarm*)	<ul style="list-style-type: none"> Faulty diaphragm Broken discharge line Pressure differential between suction and discharge side too low Leakage in the pressure retention valve at $Q > 1$ l/h Deaeration valve open 	<ul style="list-style-type: none"> Change the diaphragm (see section 7.2 <i>Perform service</i>). Check discharge line and repair if necessary. Install additional spring-loaded valve (approx. 3 bar) on the discharge side. Close the deaeration valve.
	Air bubble (Warning)	<ul style="list-style-type: none"> Broken/leaky suction line Strongly degassing medium Tank dosing medium empty 	<ul style="list-style-type: none"> Check suction line and repair if necessary. Provide positive inlet pressure (place dosing medium tank above the pump). Enable '<i>Slow Mode</i>' (see section 6.6 <i>SlowMode</i>). Fill tank.
	Cavitation (Warning)	<ul style="list-style-type: none"> Blocked/constricted/squeezed suction line Blocked/constricted suction valve Suction lift too high Viscosity too high 	<ul style="list-style-type: none"> Enable '<i>Slow Mode</i>' (see section 6.6 <i>SlowMode</i>) Reduce suction lift. Increase suction hose diameter Check suction line and open isolating valve if necessary.
	Suct. valve leak (Warning)	<ul style="list-style-type: none"> Leaky/dirty suction valve Deaeration valve open 	<ul style="list-style-type: none"> Check valve and tighten it up. Flush system. Replace valve if necessary (see section 7.2 <i>Perform service</i>). Check O-ring position. Install filter in suction line. Close the deaeration valve

	Disch. valve leak (Warning)	<ul style="list-style-type: none"> Leaky/dirty discharge valve Leakage in the pressure retention valve Deaeration valve open 	<ul style="list-style-type: none"> Check valve and tighten it up. Flush system. Replace valve if necessary (see section 7.2 <i>Perform service</i>). Check O-ring position. Install screen in suction line Close the deaeration valve. Install spring-loaded valve on the discharge side.
	Flow deviation (Warning)	<ul style="list-style-type: none"> Considerable deviation between target and actual flow Pump no / incorrectly calibrated 	<ul style="list-style-type: none"> Check installation Calibrate the pump (see section 5.3 <i>Calibrating the pump</i>)
	Pressure sensor (Warning)	<ul style="list-style-type: none"> Broken FlowControl cable Sensor defect Pressure sensor not correctly calibrated. 	<ul style="list-style-type: none"> Check plug connection. Change sensor if necessary. Calibrate pressure sensor correctly (see section 6.8.2 <i>Calibration of pressure sensor</i>).
	Motor blocked (Alarm)	<ul style="list-style-type: none"> Backpressure greater than nominal pressure Damage to gears 	<ul style="list-style-type: none"> Reduce backpressure. Arrange for repair of gears, if necessary.
BUS	Bus (Warning/alarm*)	<ul style="list-style-type: none"> Fieldbus communication error 	<ul style="list-style-type: none"> Check cables for correct specification and damage; replace if necessary. Check cable routing and shielding; correct if necessary.
	E-Box (Alarm)	<ul style="list-style-type: none"> E-Box connection error Faulty E-Box 	<ul style="list-style-type: none"> Check plug connection Replace E-Box if necessary.
	Cable break (Alarm)	<ul style="list-style-type: none"> Defect in analog cable 4-20 mA (input current < 2 mA) 	<ul style="list-style-type: none"> Check cable/plug connections and replace, if necessary. Check signal transmitter.
	Service soon/now (Warning)	<ul style="list-style-type: none"> Time interval for service expired 	<ul style="list-style-type: none"> Perform service (see section 7.2 <i>Perform service</i>)

* Depending on setting

8.1.2 General faults

Fault	Possible cause	Possible remedy
Dosing flow too high	Inlet pressure greater than backpressure	<ul style="list-style-type: none"> Install additional spring-loaded valve (approx. 3 bar) on the discharge side. Increase pressure differential.
	Incorrect calibration	Calibrate the pump (see section 5.3 <i>Calibrating the pump</i>).
No dosing flow or dosing flow too low	Air in dosing head	Deaerate the pump
	Faulty diaphragm	Change the diaphragm (see section 7.2 <i>Perform service</i>).
	Leakage/fracture in lines	Check and repair lines.
	Valves leaking or blocked	Check and clean valves.
	Valves installed incorrectly	<ul style="list-style-type: none"> Check that the arrow on the valve housing is pointing in the direction of flow. Check whether all O-rings are installed correctly.
	Blocked suction line	<ul style="list-style-type: none"> Clean suction line/install filter.
	Suction lift too high	<ul style="list-style-type: none"> Reduce suction lift. Install priming aid. Enable 'Slow Mode' (see section 6.6 <i>SlowMode</i>).
	Viscosity too high	<ul style="list-style-type: none"> Enable 'Slow Mode' (see section 6.6 <i>SlowMode</i>). Use hose with larger diameter. Install spring-loaded valve on the discharge side.
	Pump outside the calibration	<ul style="list-style-type: none"> Calibrate the pump (see section 5.3 <i>Calibrating the pump</i>).
Irregular dosing	Deaeration valve open	<ul style="list-style-type: none"> Close the deaeration valve.
	Valves leaking or blocked	Tighten up valves, replace valves if necessary (see section 7.2 <i>Perform service</i>).
	Backpressure fluctuations	<ul style="list-style-type: none"> Keep backpressure constant. 'AutoFlowAdapt' activate (only FCM).
Liquid escaping from the discharge opening on the flange	Faulty diaphragm	Change the diaphragm (see section 7.2 <i>Perform service</i>).
Liquid escaping	Dosing head screws not screwed in as far as they will go	Tighten up screws (see section 4.2 <i>Hydraulic connection</i>).
	Valves not screwed in as far as they will go	Tighten up valves/union nuts (see section 4.2 <i>Hydraulic connection</i>).
Pump not sucking in	Suction lift too high	Reduce suction lift, if necessary provide positive inlet pressure.
	Backpressure too high	Open the deaeration valve.
	Soiled valves	Flush system, replace valves if necessary (see section 7.2 <i>Perform service</i>).

9. Disposal

This product and all its associated parts must be disposed of in an environmentally friendly manner. Use appropriate waste collection services. If there is no such facility or the facility refuses to accept these materials used in the product, the product can be sent to the Fink Chem + Tec OHG.

Appendix


Safety declaration

Please copy, fill in and sign this sheet and attach it to the pump returned for service.

Product type (nameplate) _____
Model- number (nameplate) _____
Dosing medium _____

Fault description

Please make a circle around the damaged parts.
In the case of an electrical or functional fault, please mark the cabinet.

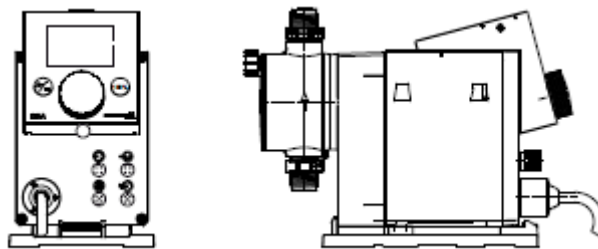

Please describe the error / cause of the error in brief.

We hereby declare that the pump has been cleaned and is completely free from chemical, biological and radioactive substances.

Date, signature and Company stamp

© 2014 Fink Chem + Tec OHG

The texts, images and examples in this manual are carefully compiled. Fink Chem + Tec OHG is not liable for possible remaining incorrect details and following consequences or breach of other third party rights neither legal responsibility nor other liability. We are thankful for any notifications or improvement suggestions.

The material, Soft and Hardware terms and names mentioned in this manual are usually registered trademarks and underlie the legal regulations.

The manual protected by copyright. All rights reserved. No part of this manual may be reproduced by photo copy, microfilm or other means or transferred to machines, especially data processing equipment, in the appropriate language. Presentation by submission in lectures, radio and television is allowed only with our written consent.

EG - Declaration of Conformity

Machinery Directive 2006/42/EG, II 1, A

Membrane Metering Pumps

R 033-xx

Manufacturer Fink Chem+Tec GmbH & Co. KG
Maybachstraße 11
70771 Leinfelden-Echterdingen

We declare that this delivered R 033/DDA Metering Pump and in all versions are in conformity with the following standards or standardized documents according to the provisions of the directives of the EC state members.

- Machinery Directive (2006/42/EG).
Standards used:
EN 809: 1998
EN ISO 12100-1+A1: 2009
EN ISO 12100-2+A1: 2009
- EMC Directive (2004/108/EG).
Standards used:
EN 61000-6-2: 2005,
EN 61000-6-4: 2007
- Low Voltage Directive (2006/95/EG).
Standard used: EN 60204-1+A1: 2009
- Electrical equipment applicated within specified voltage ranges
Norm EN 61 010 -1 und EN 61 010-2-010/A1

Person authorised to compile technical file and empowered to sign the EC declaration of conformity.

Manufacturer/Supplier
Grundfos/Fink Chem+Tec GmbH & Co. KG

A. Fink

Date
16.07.2014